




№1

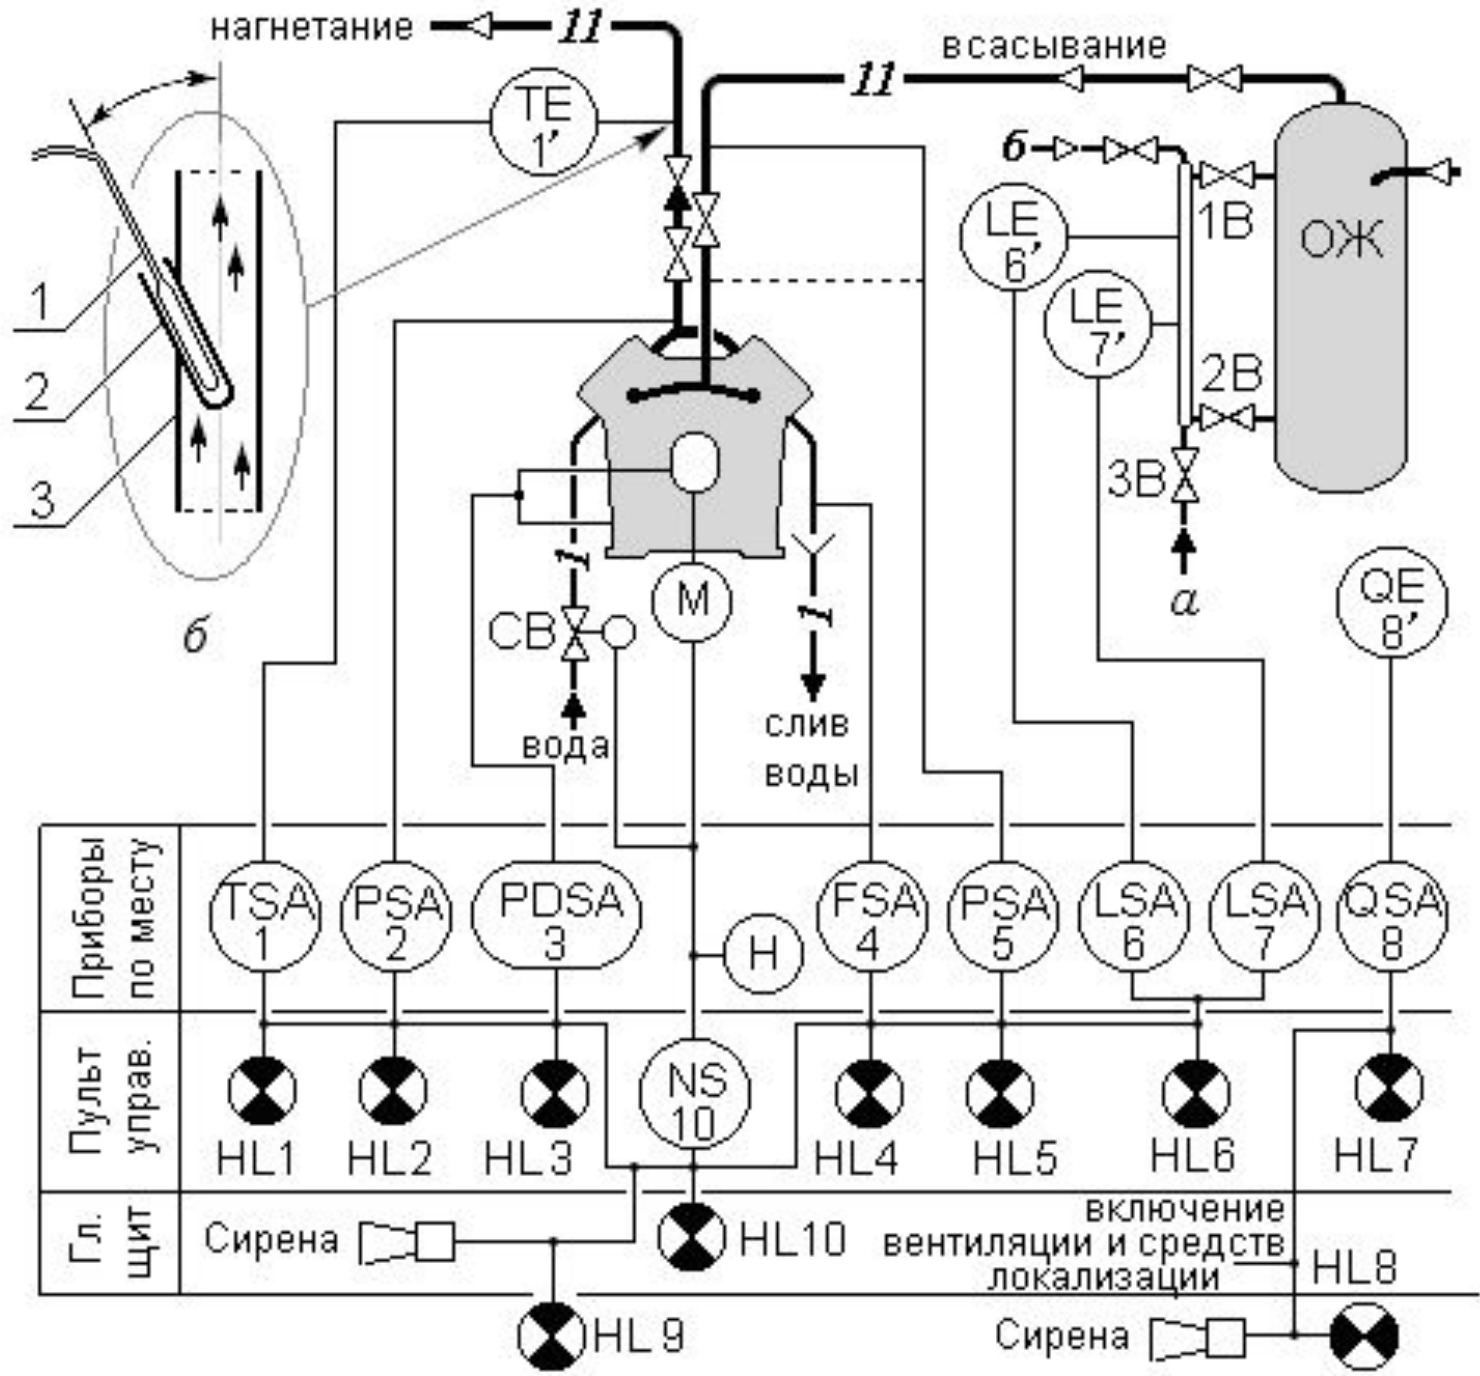

№2

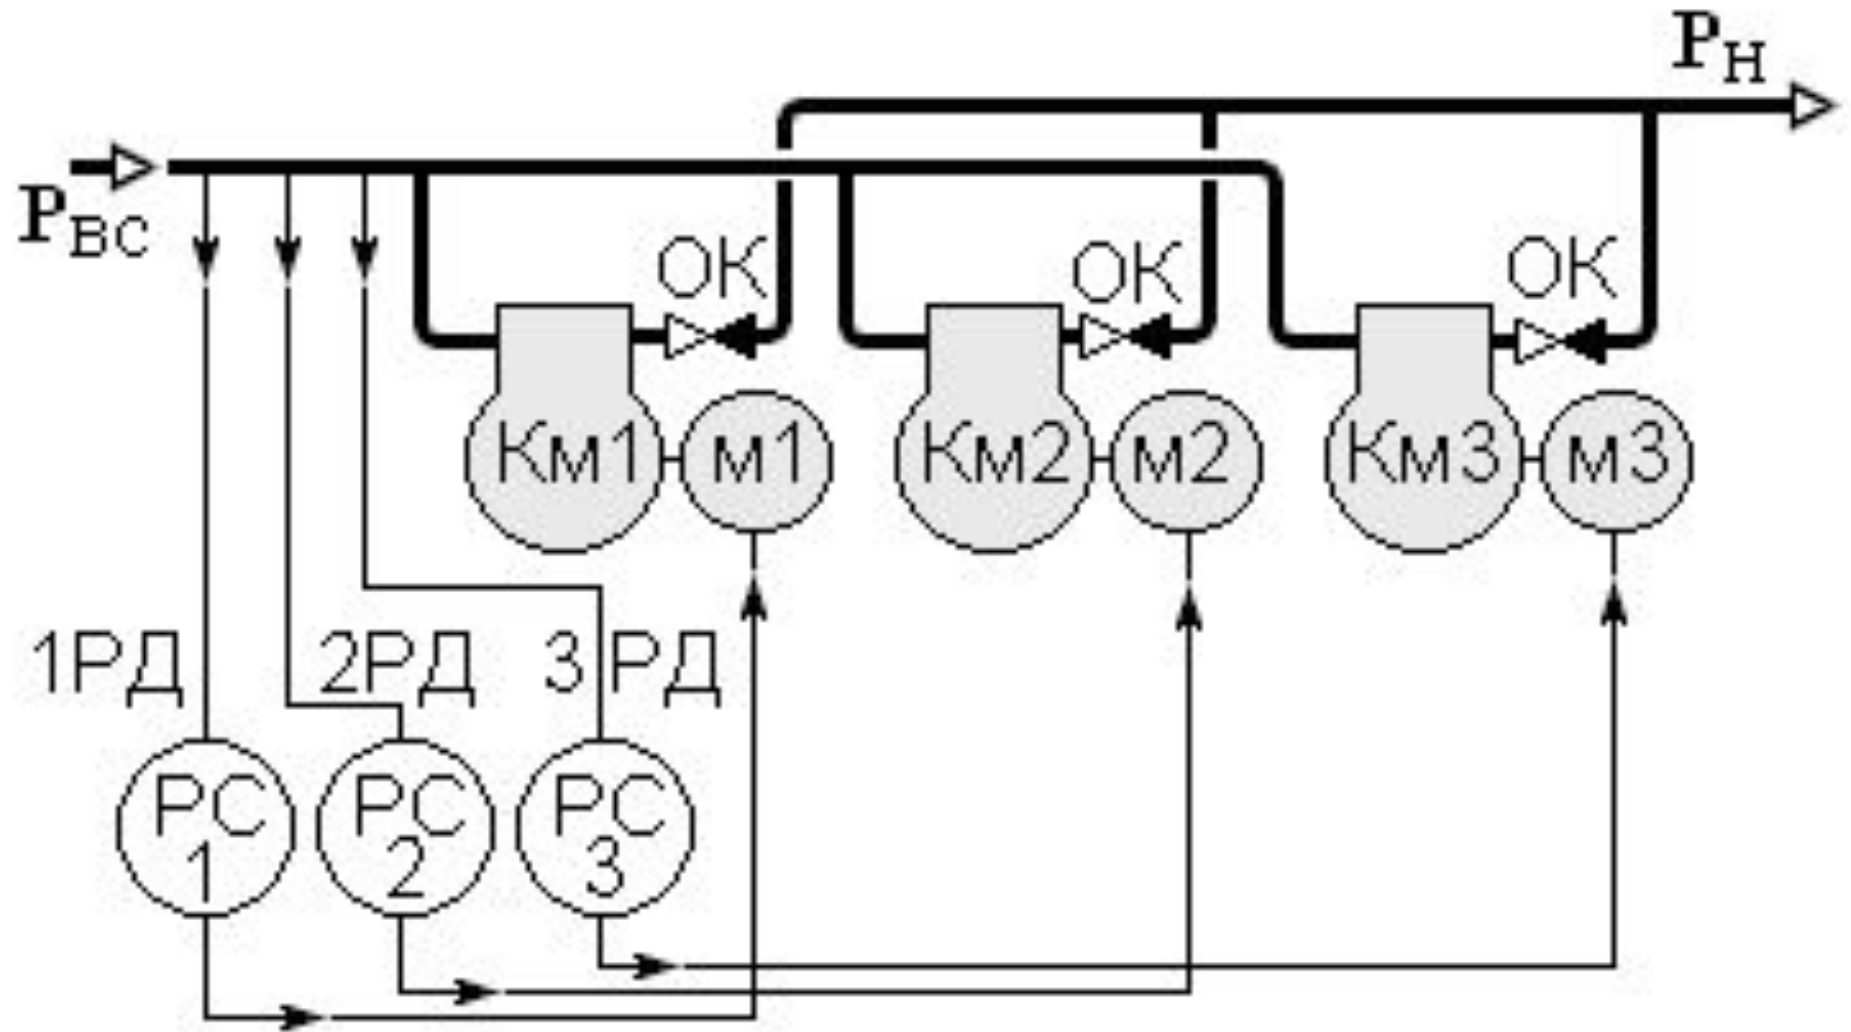



№3

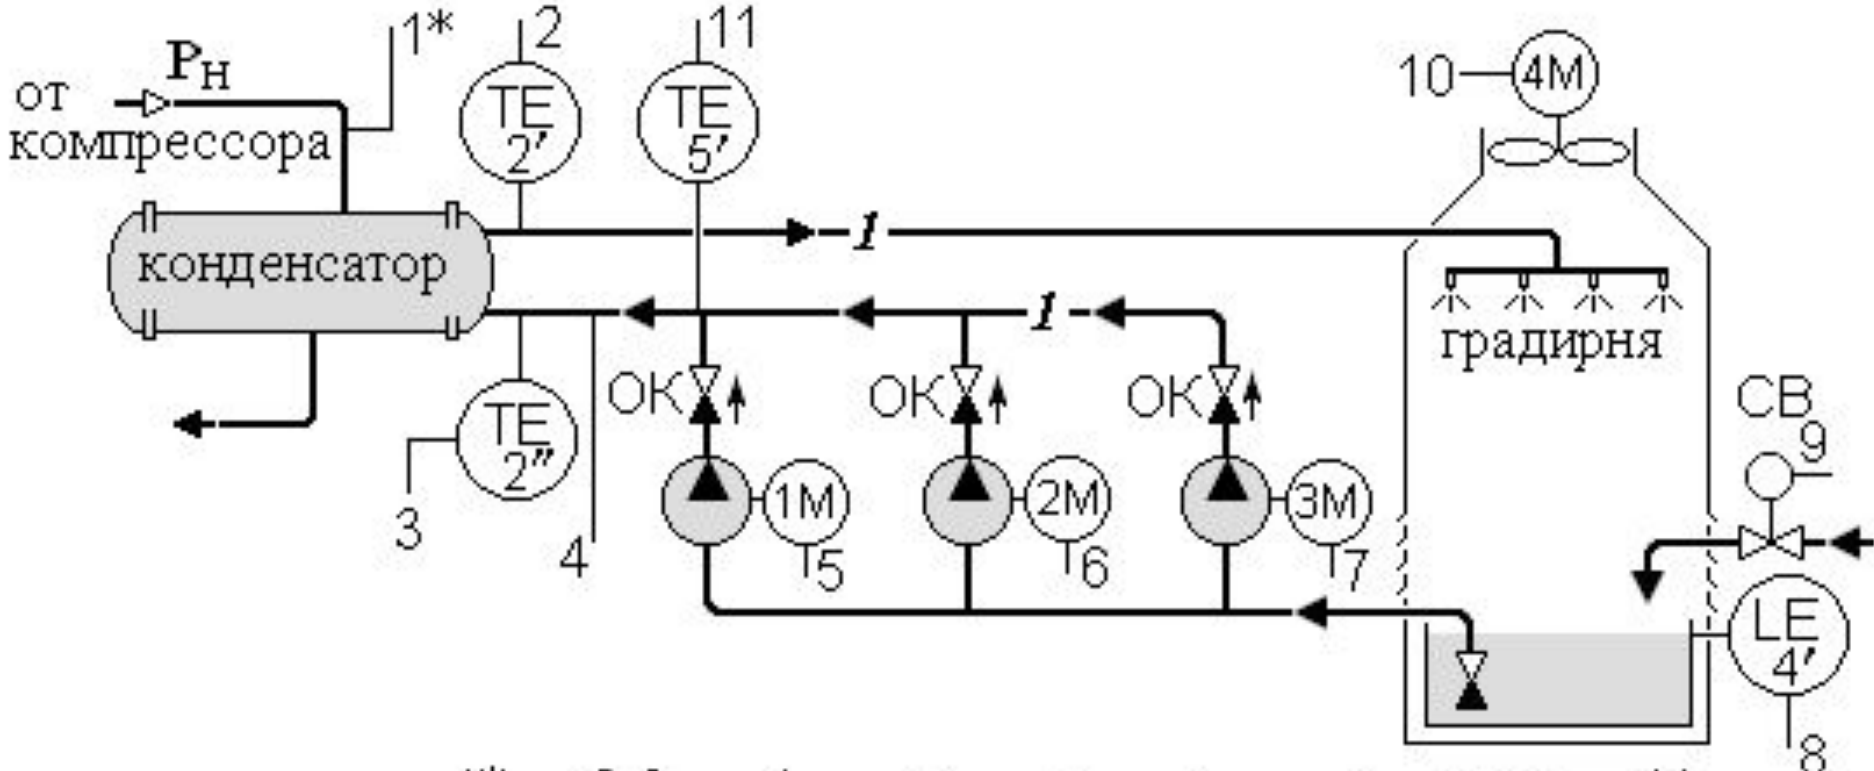


	1*	2	3	4	5	6	7	8	9	10	11
Приборы по месту	PC 1	TDC 2	PS 3		KM1	KM2	KM3	LC 4		KM4	TS 5
Щит управления				CAУ	Н	Н	Н			Н	

№4


датчики температуры
потребителей холода

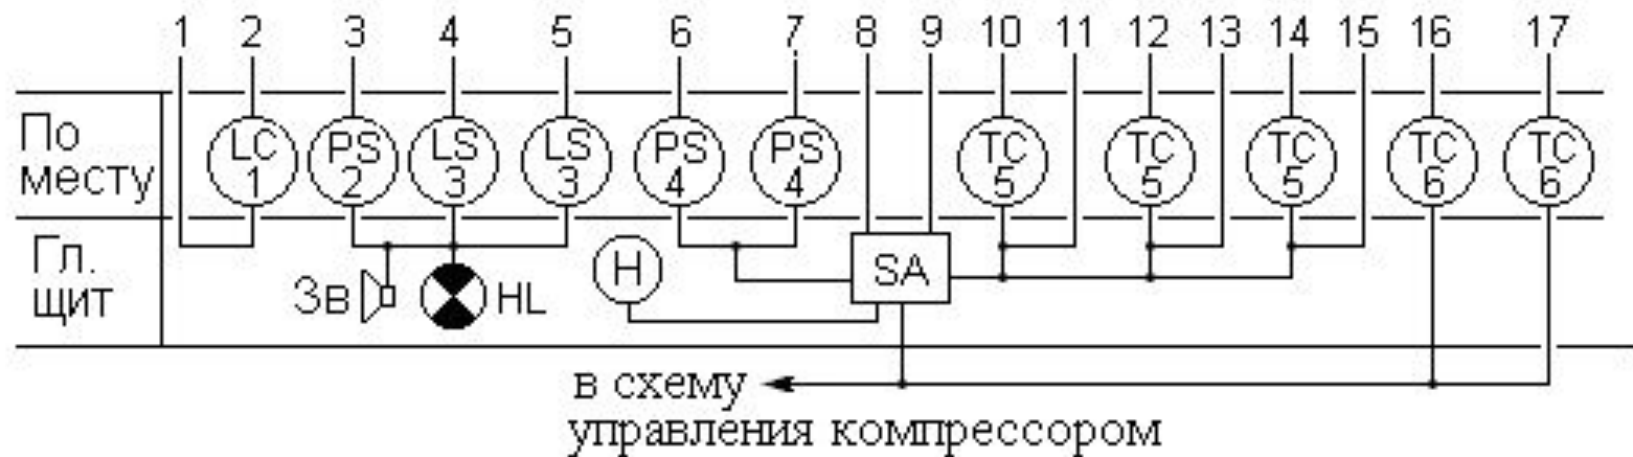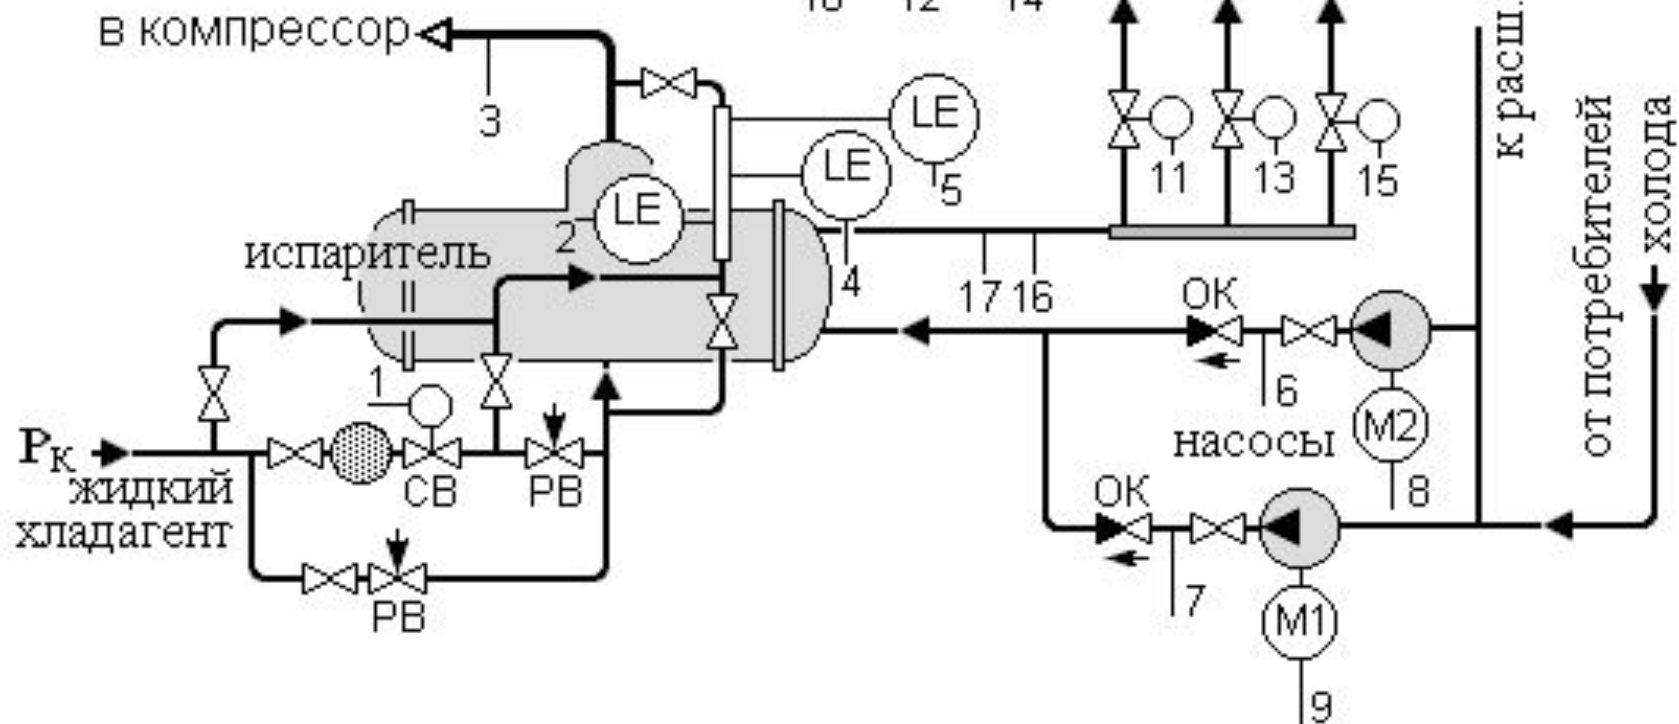


№5

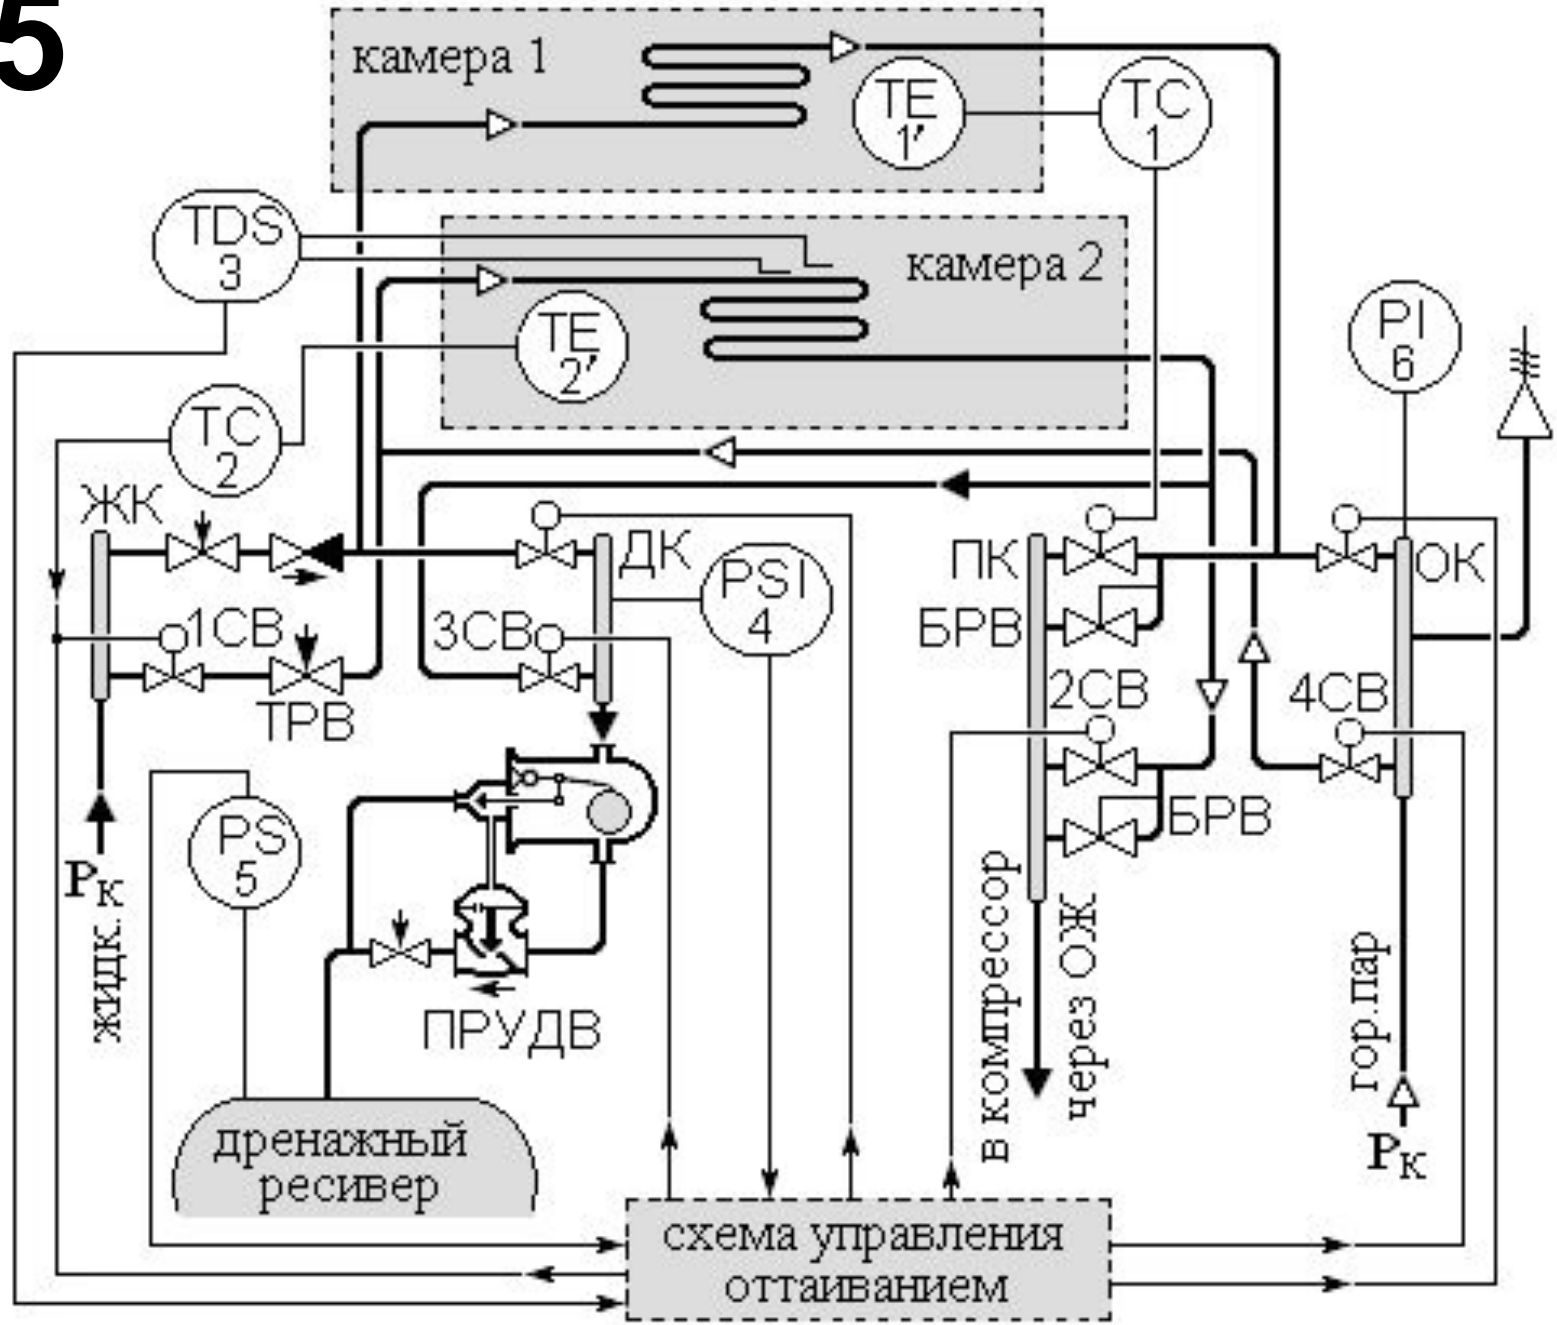


№6

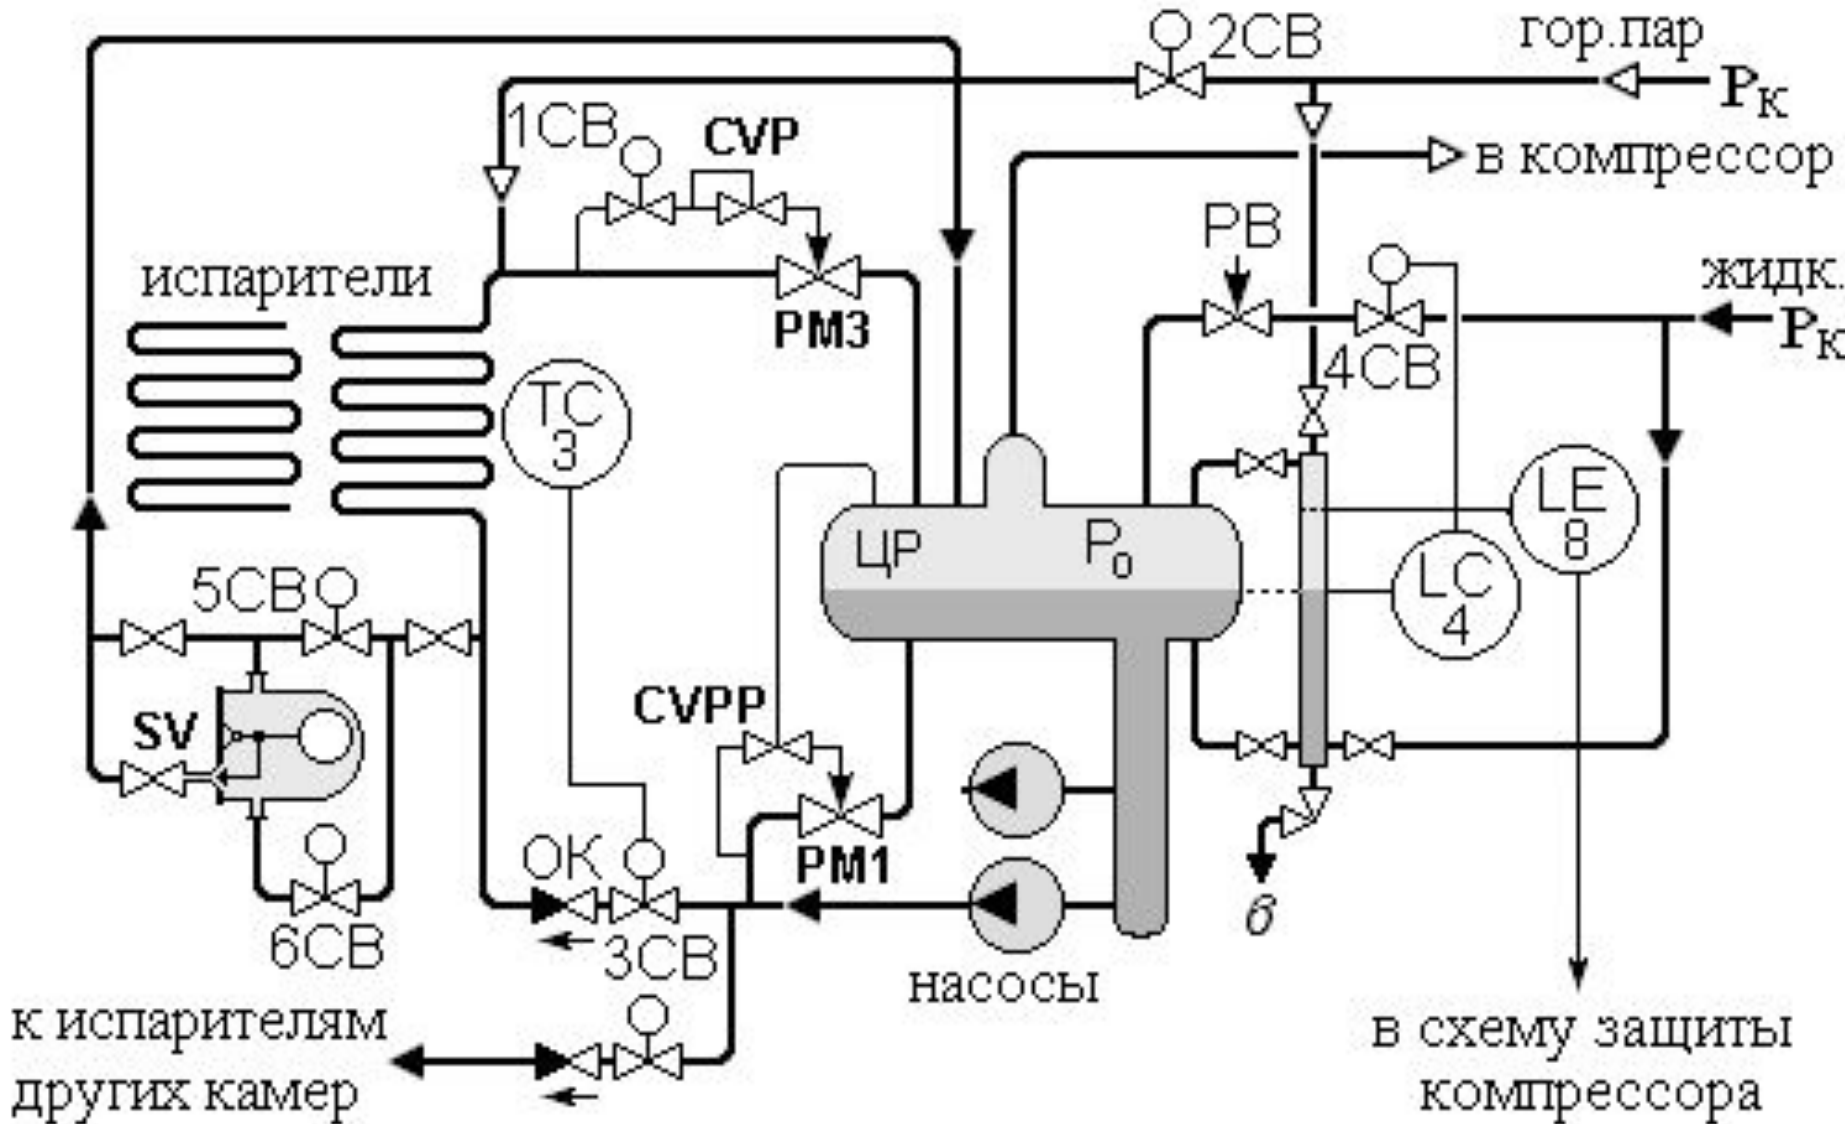

№7

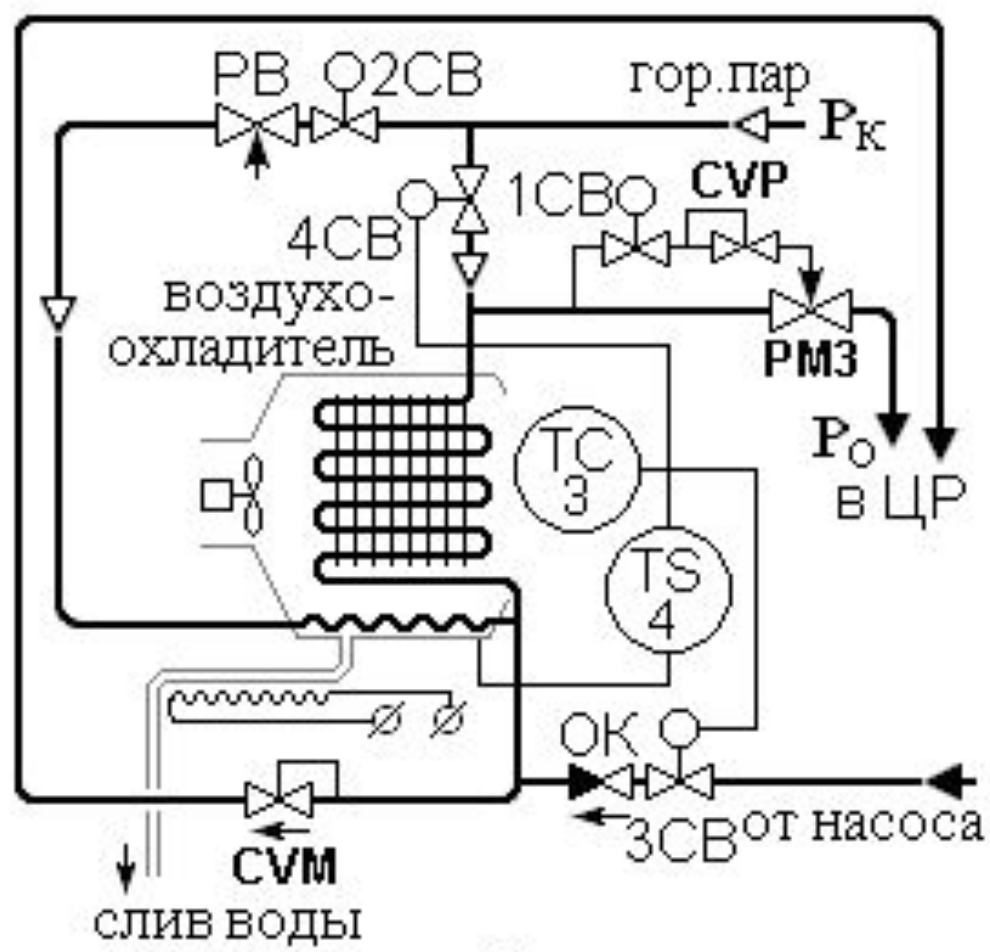


а


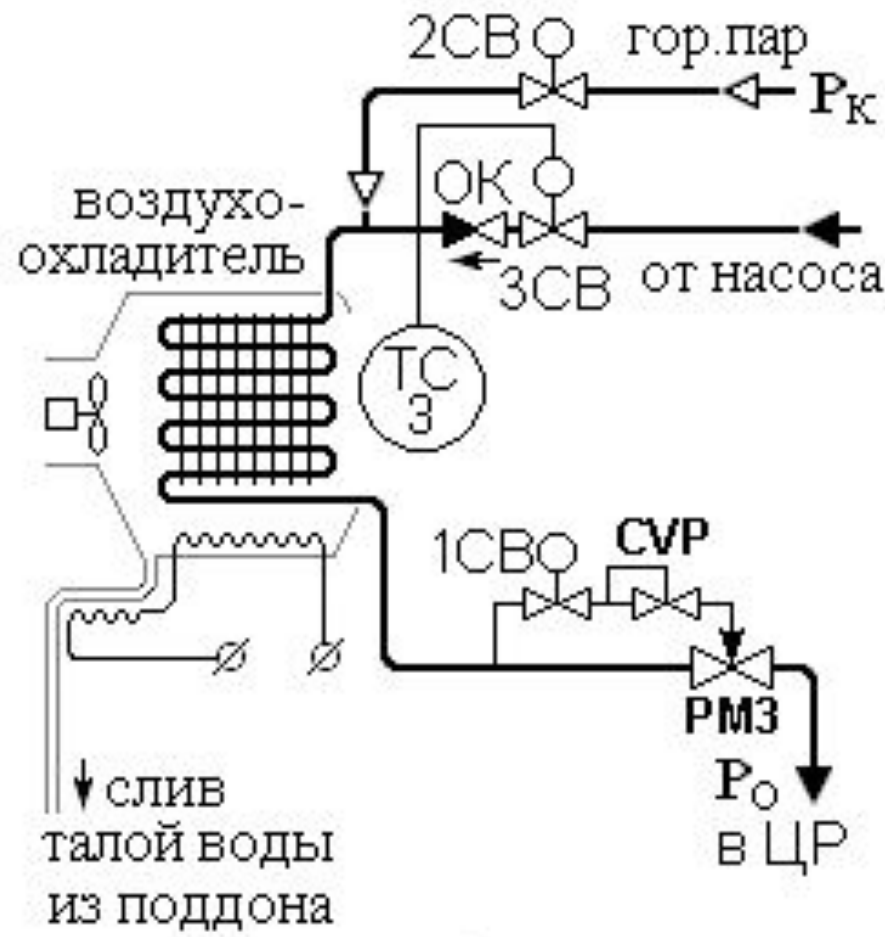


б


№8

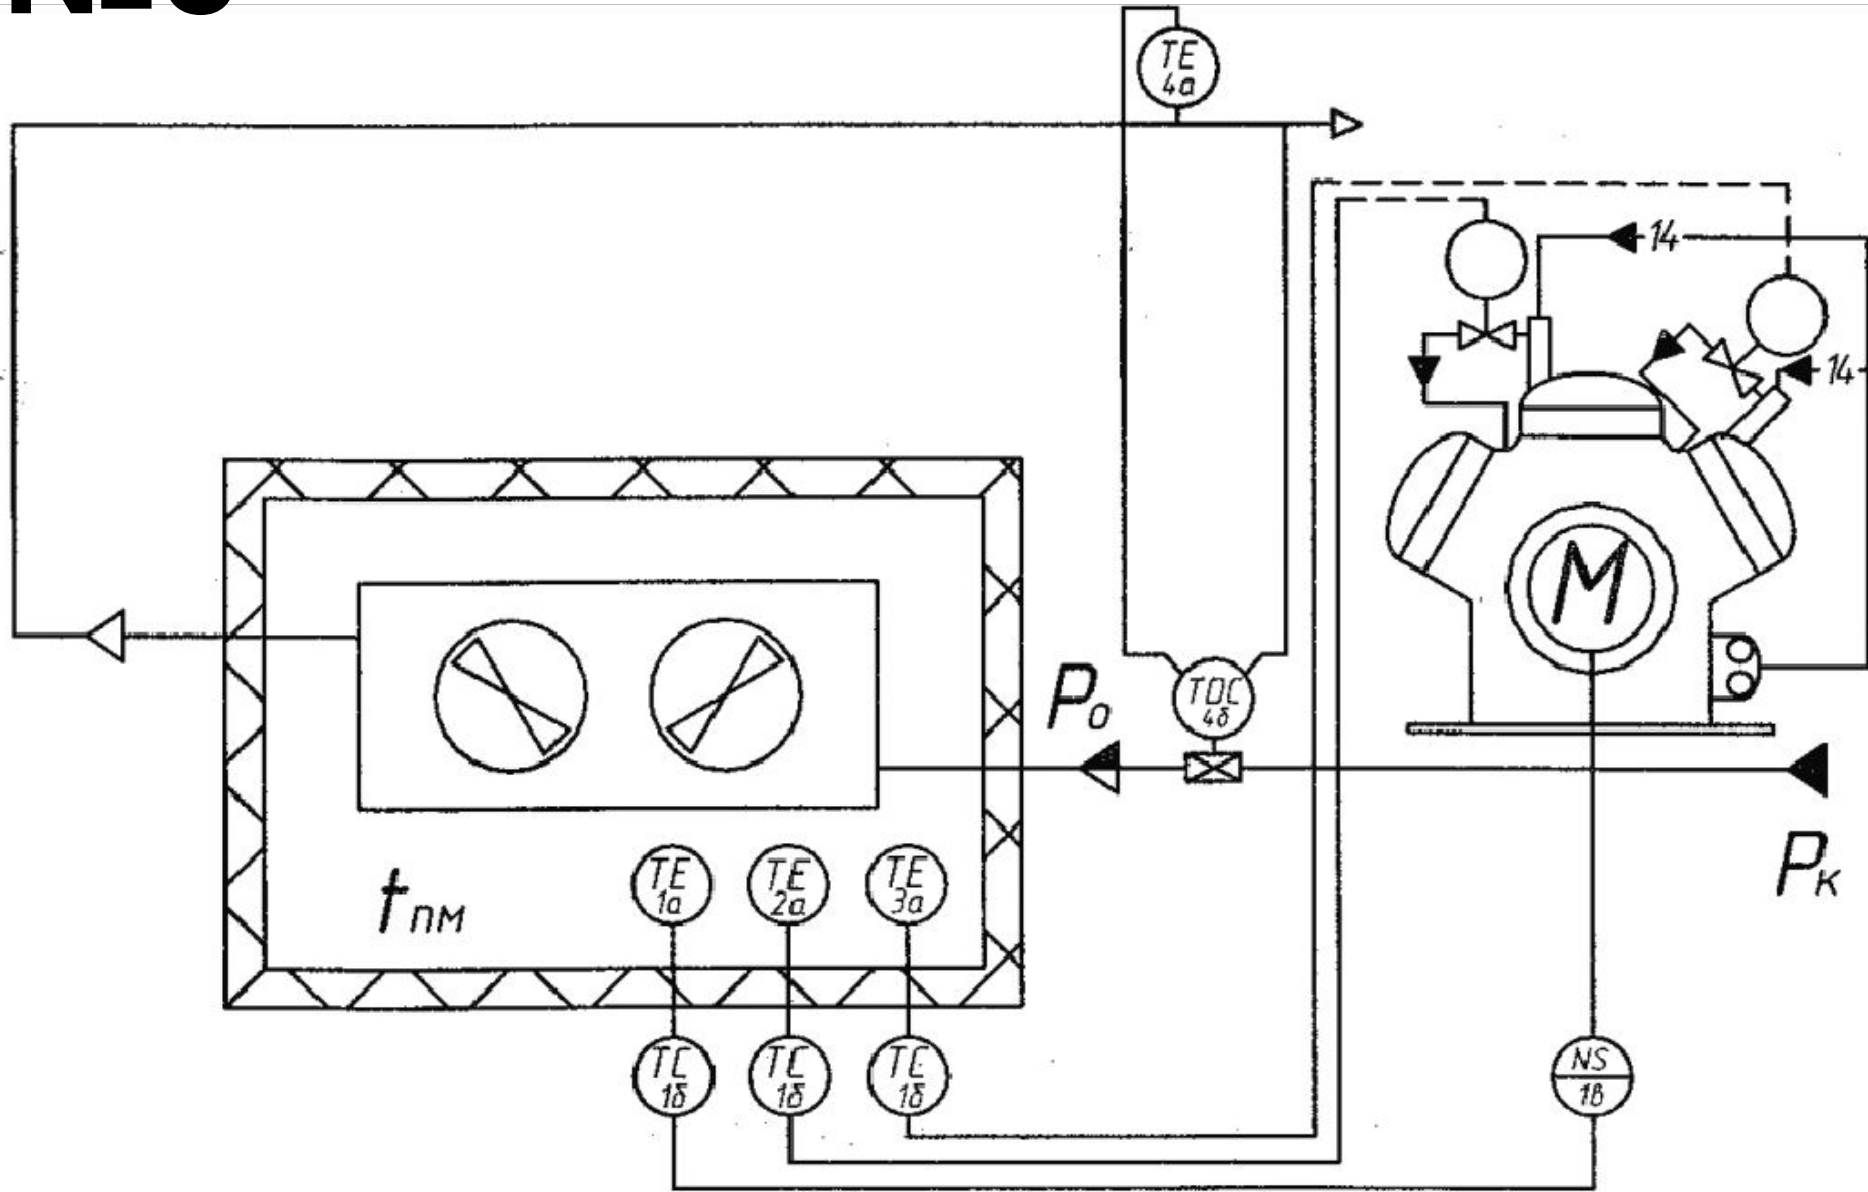

№9

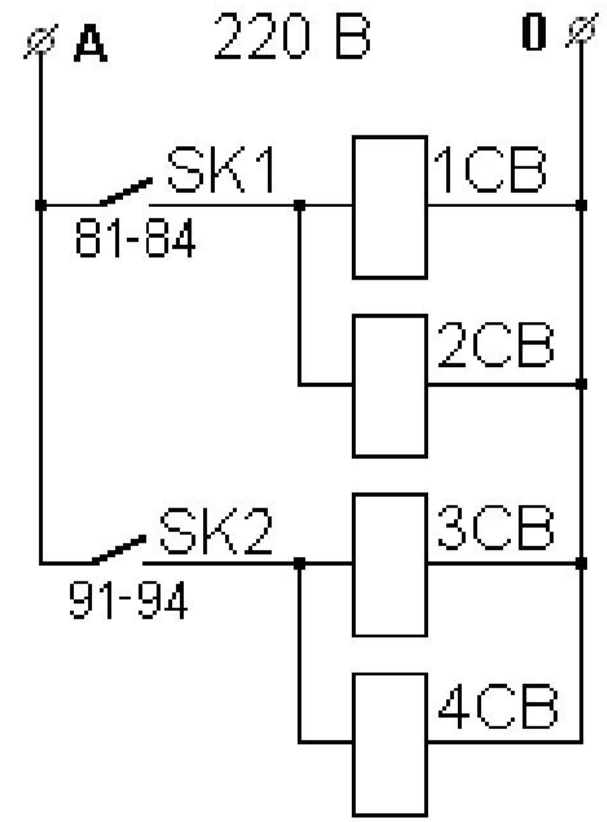
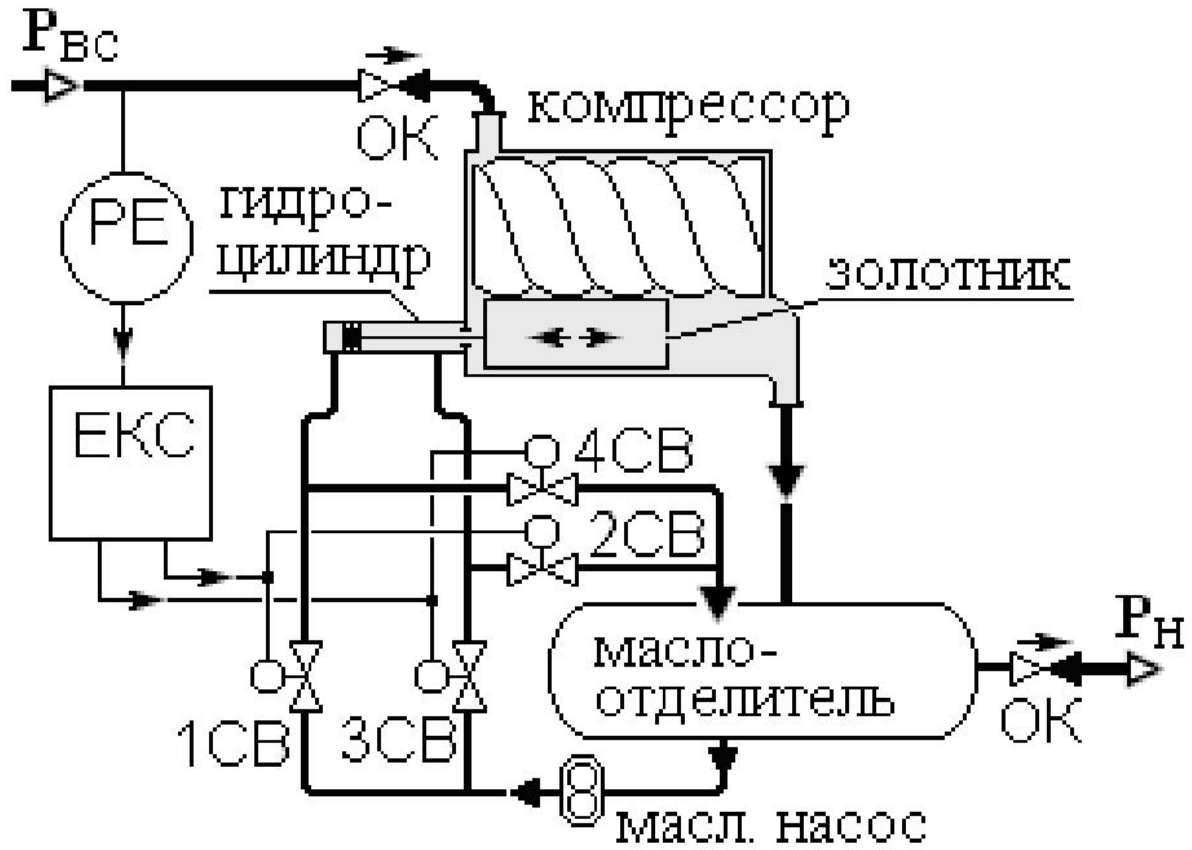


№10

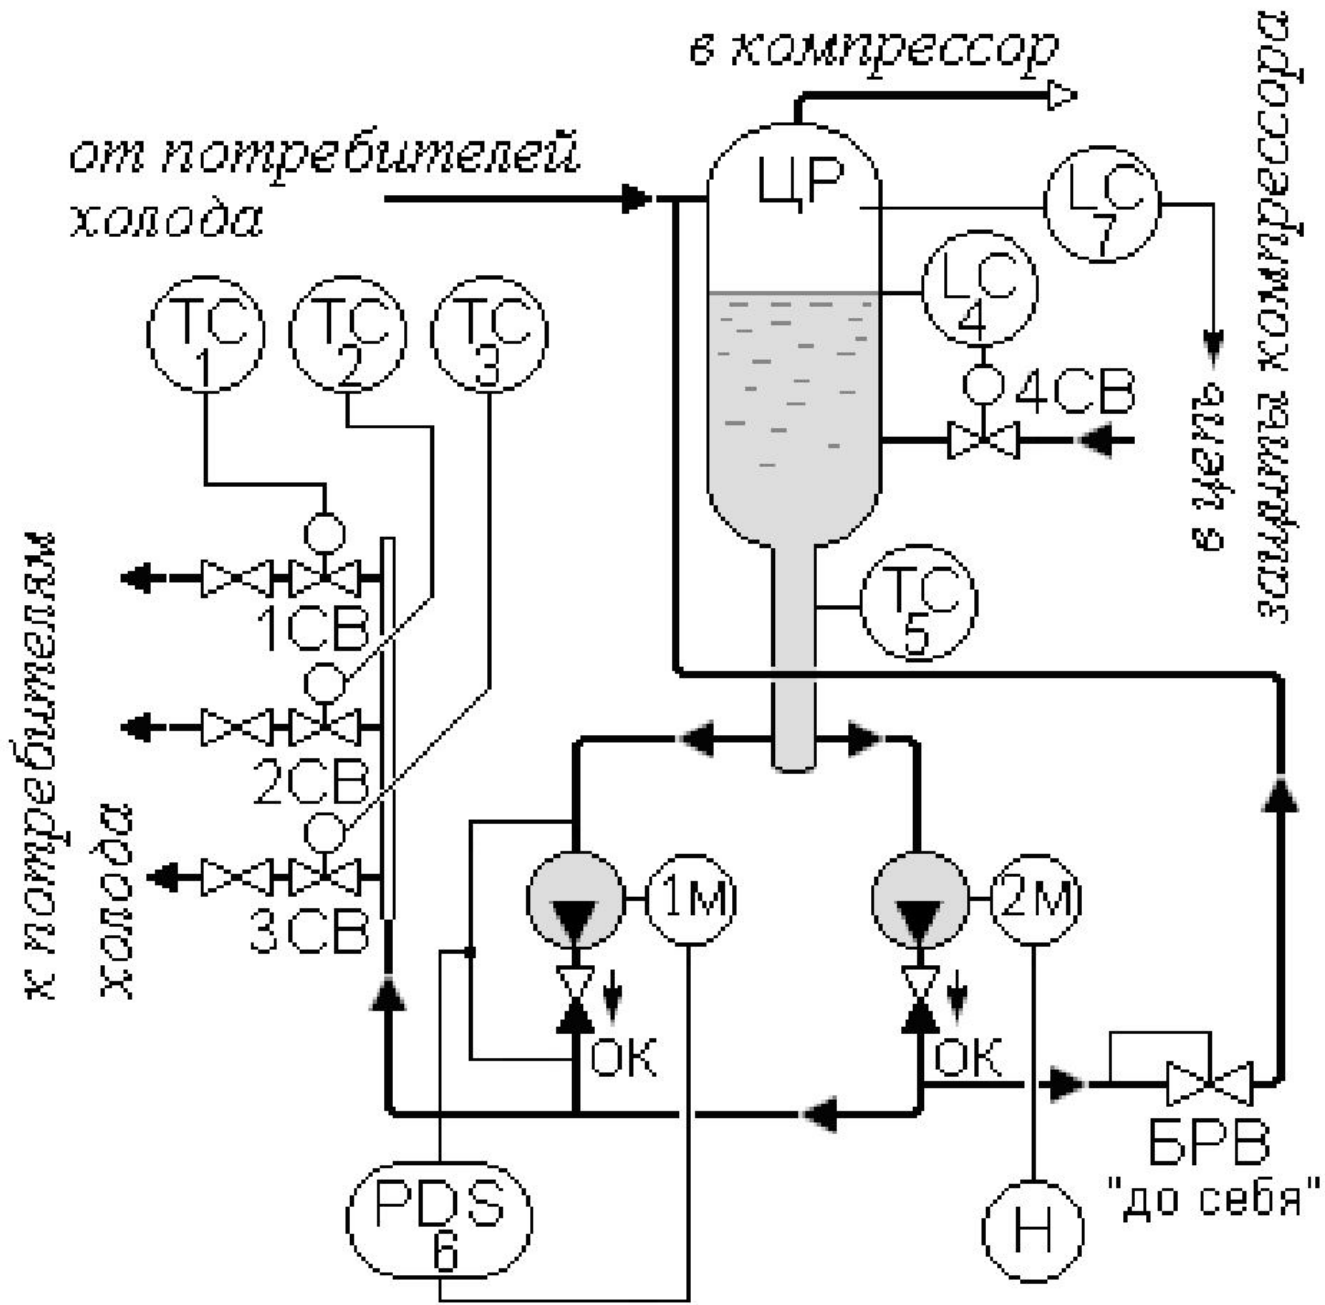


№1


1

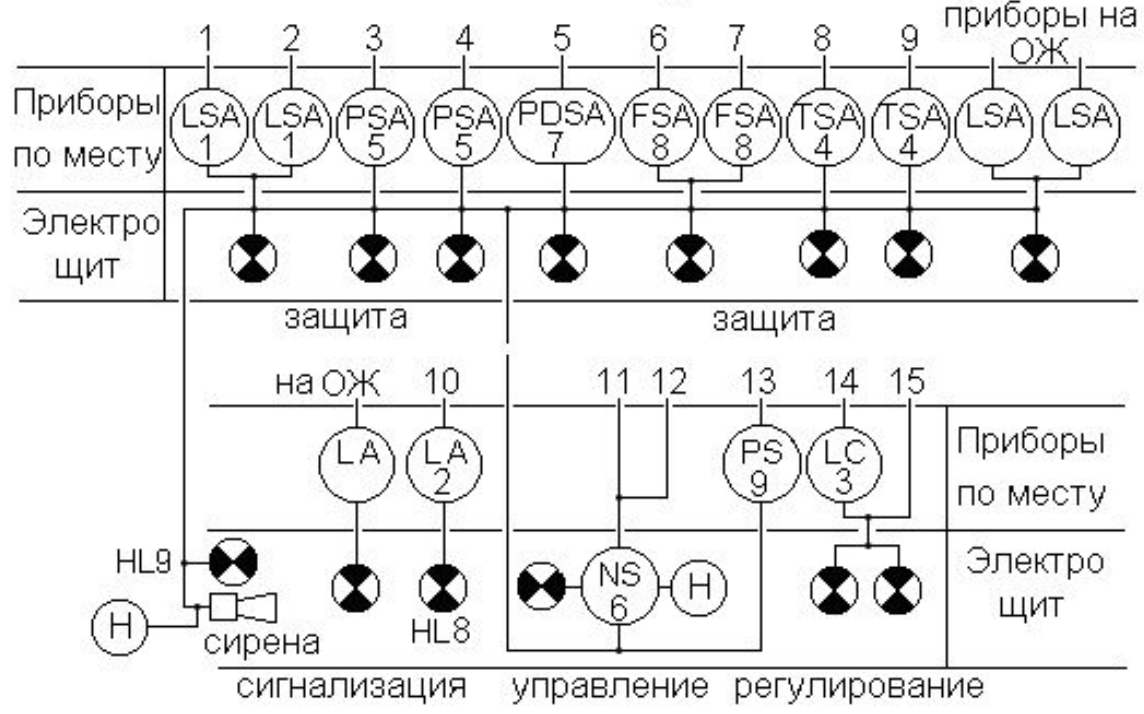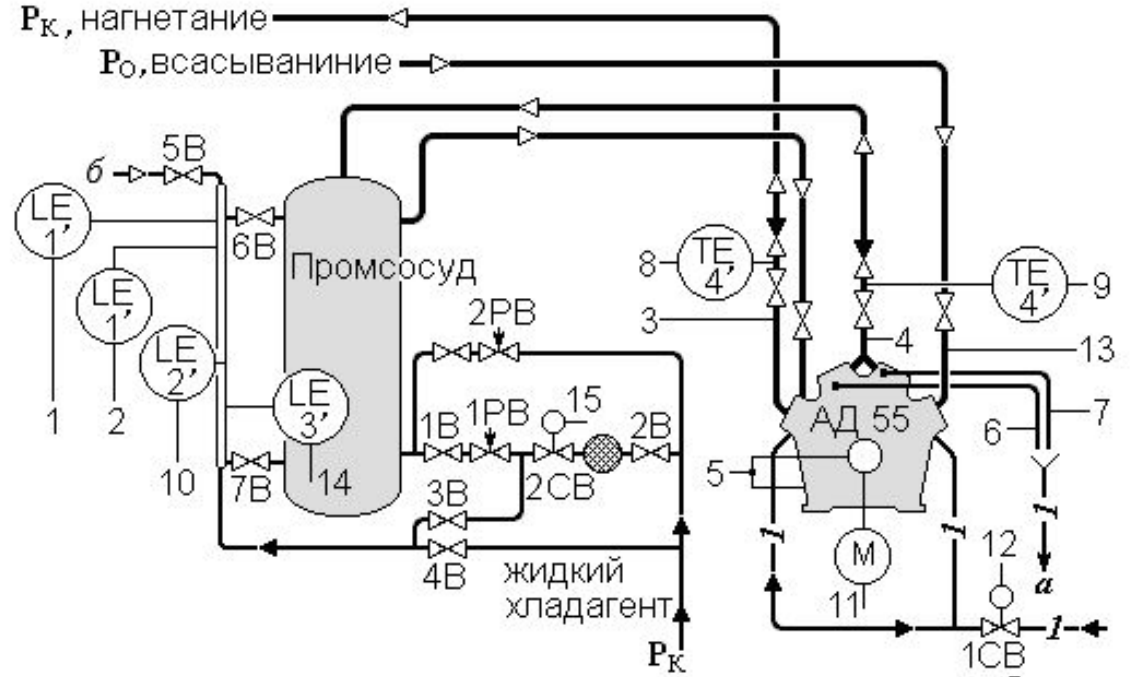


№12

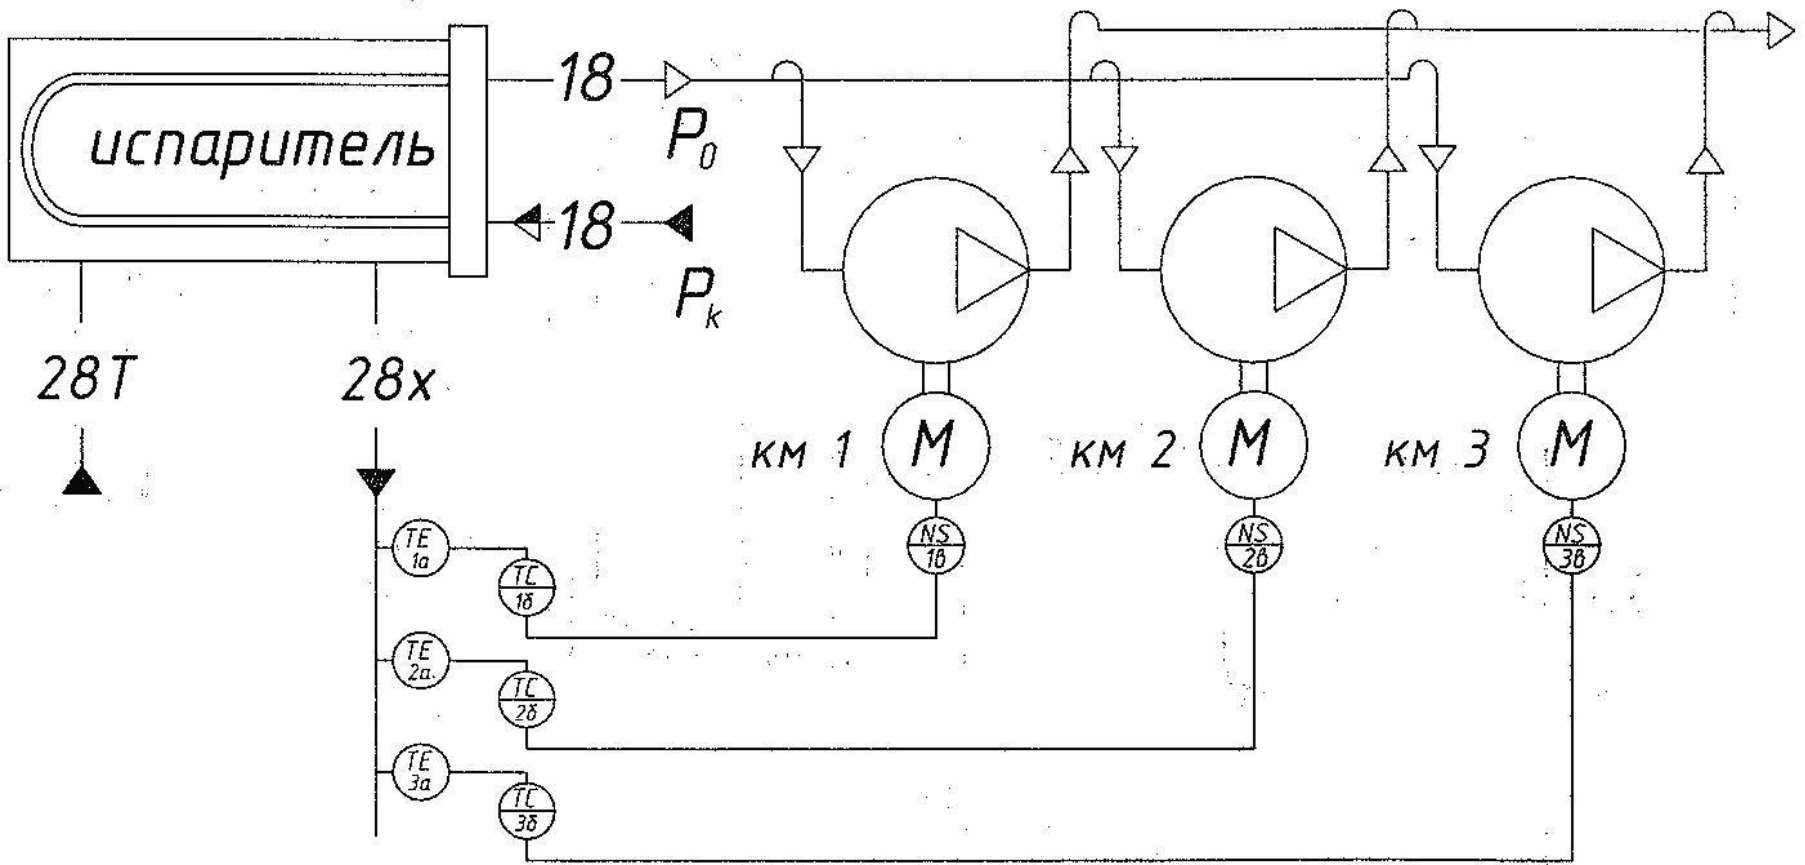


№13

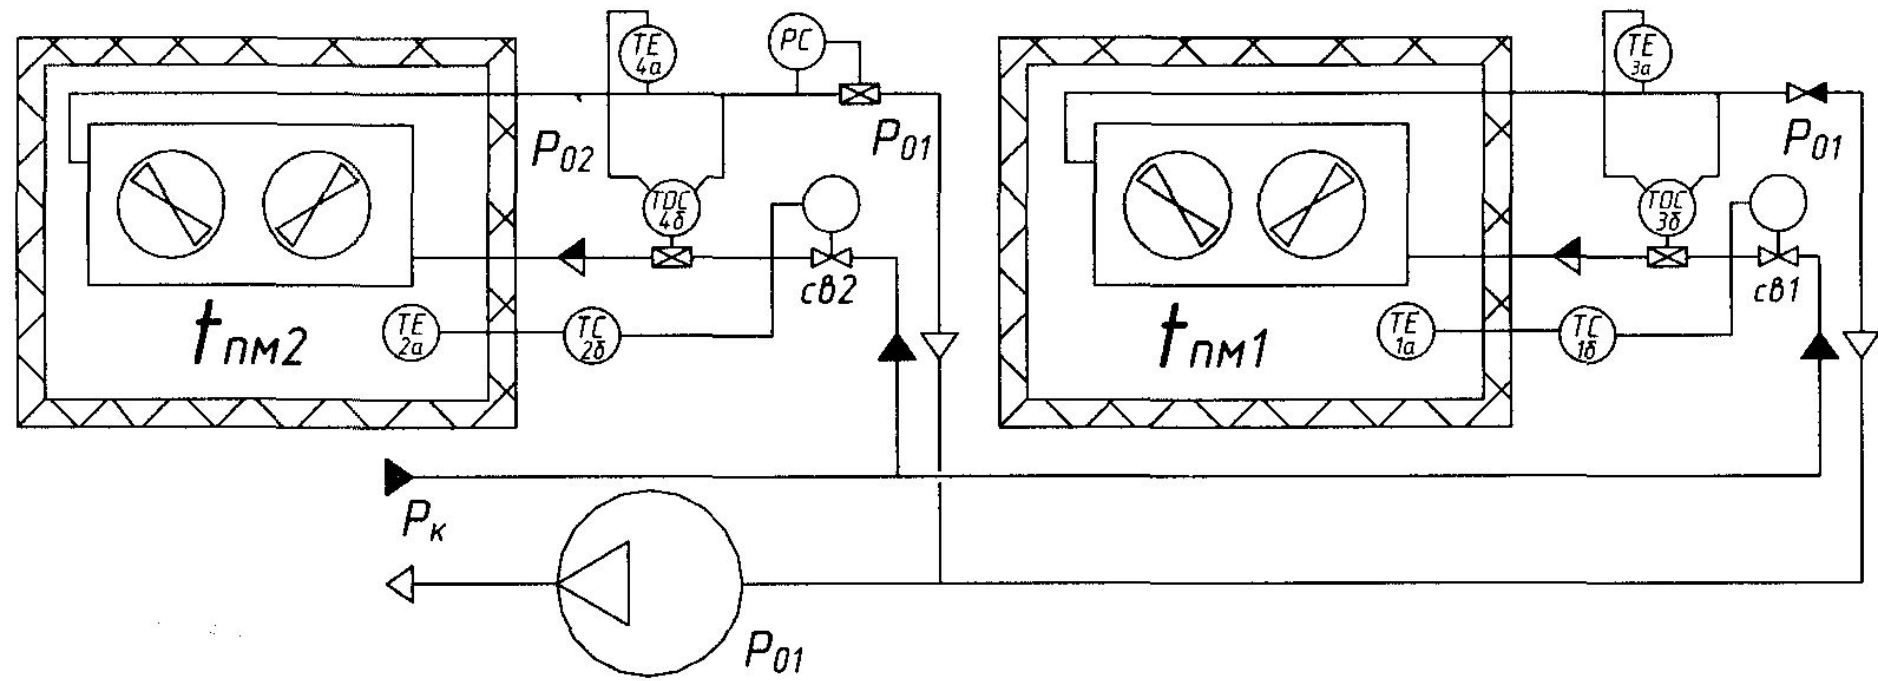


№14

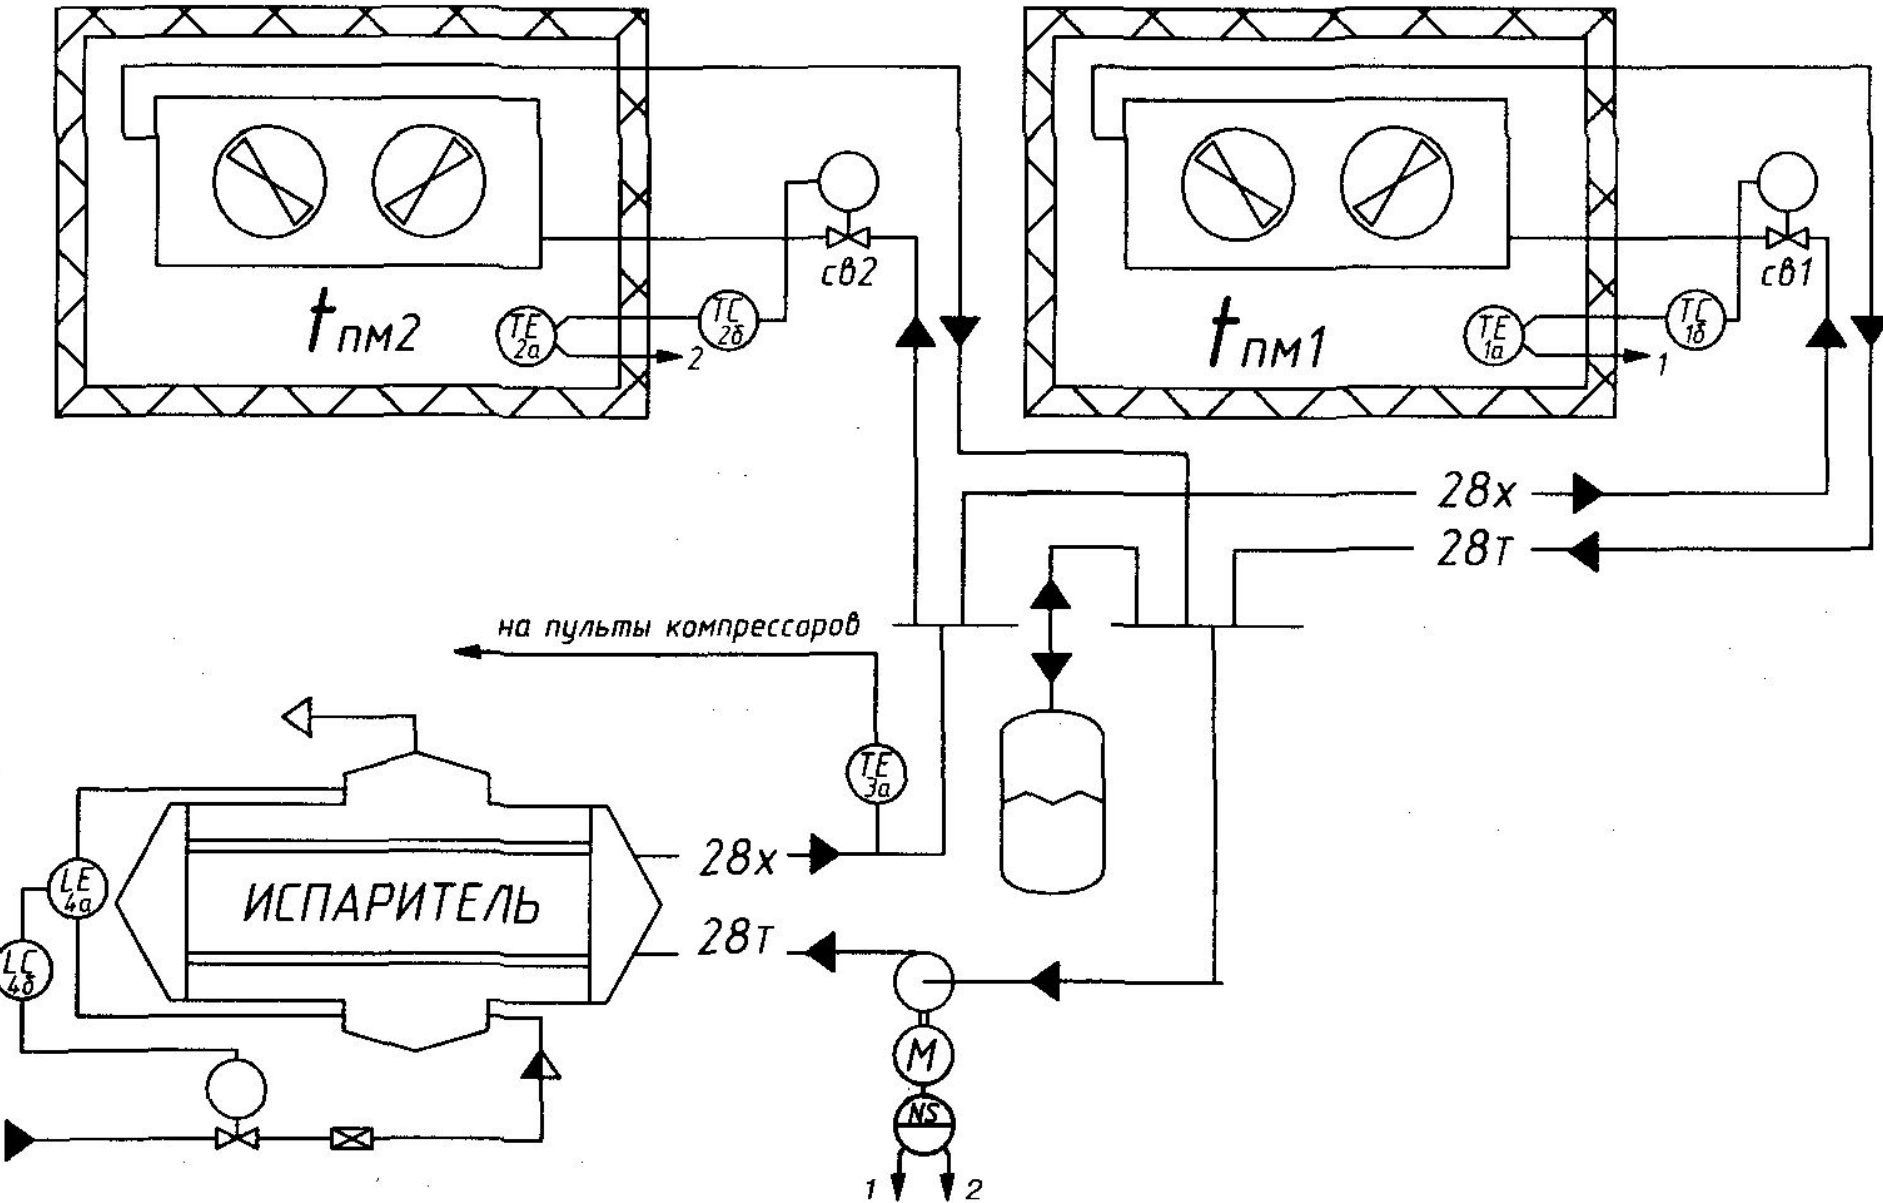


№15

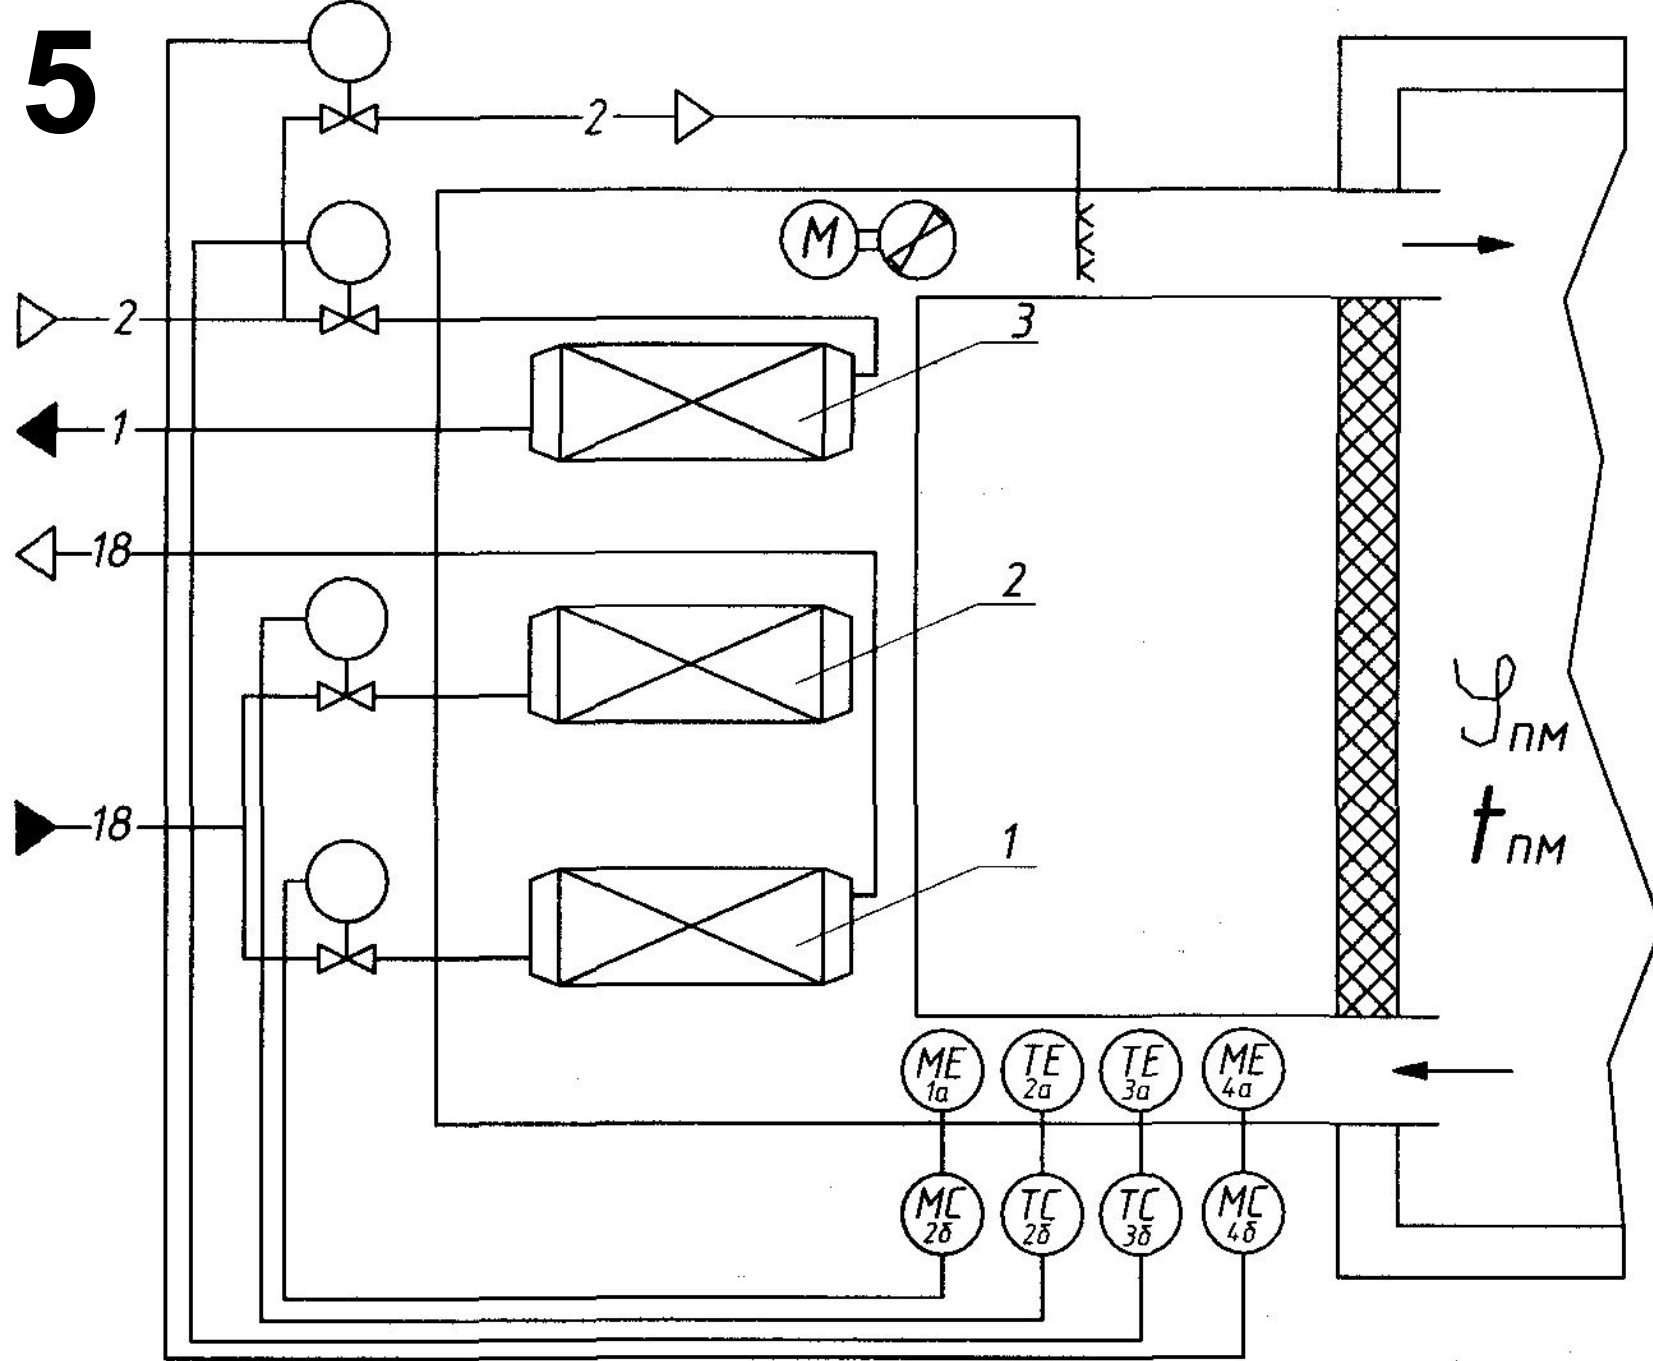


№16

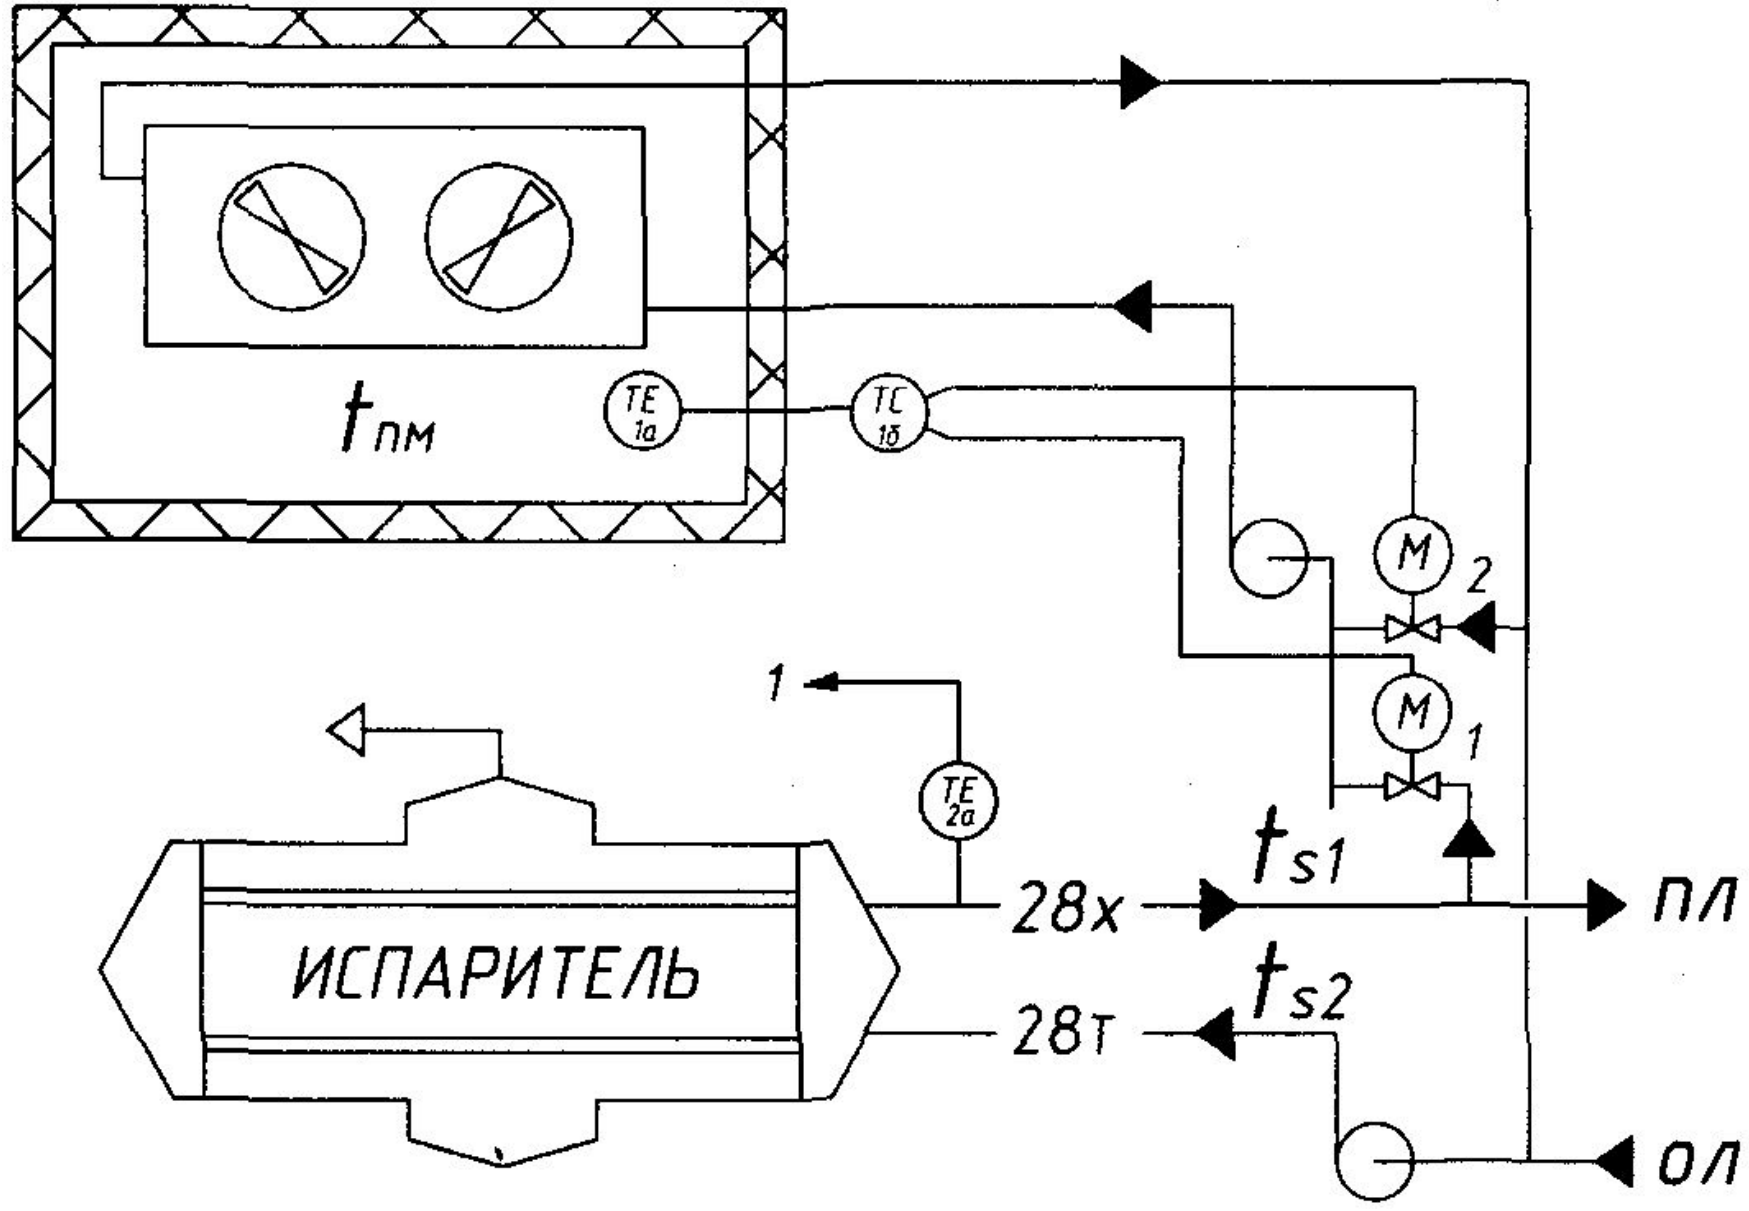



№17

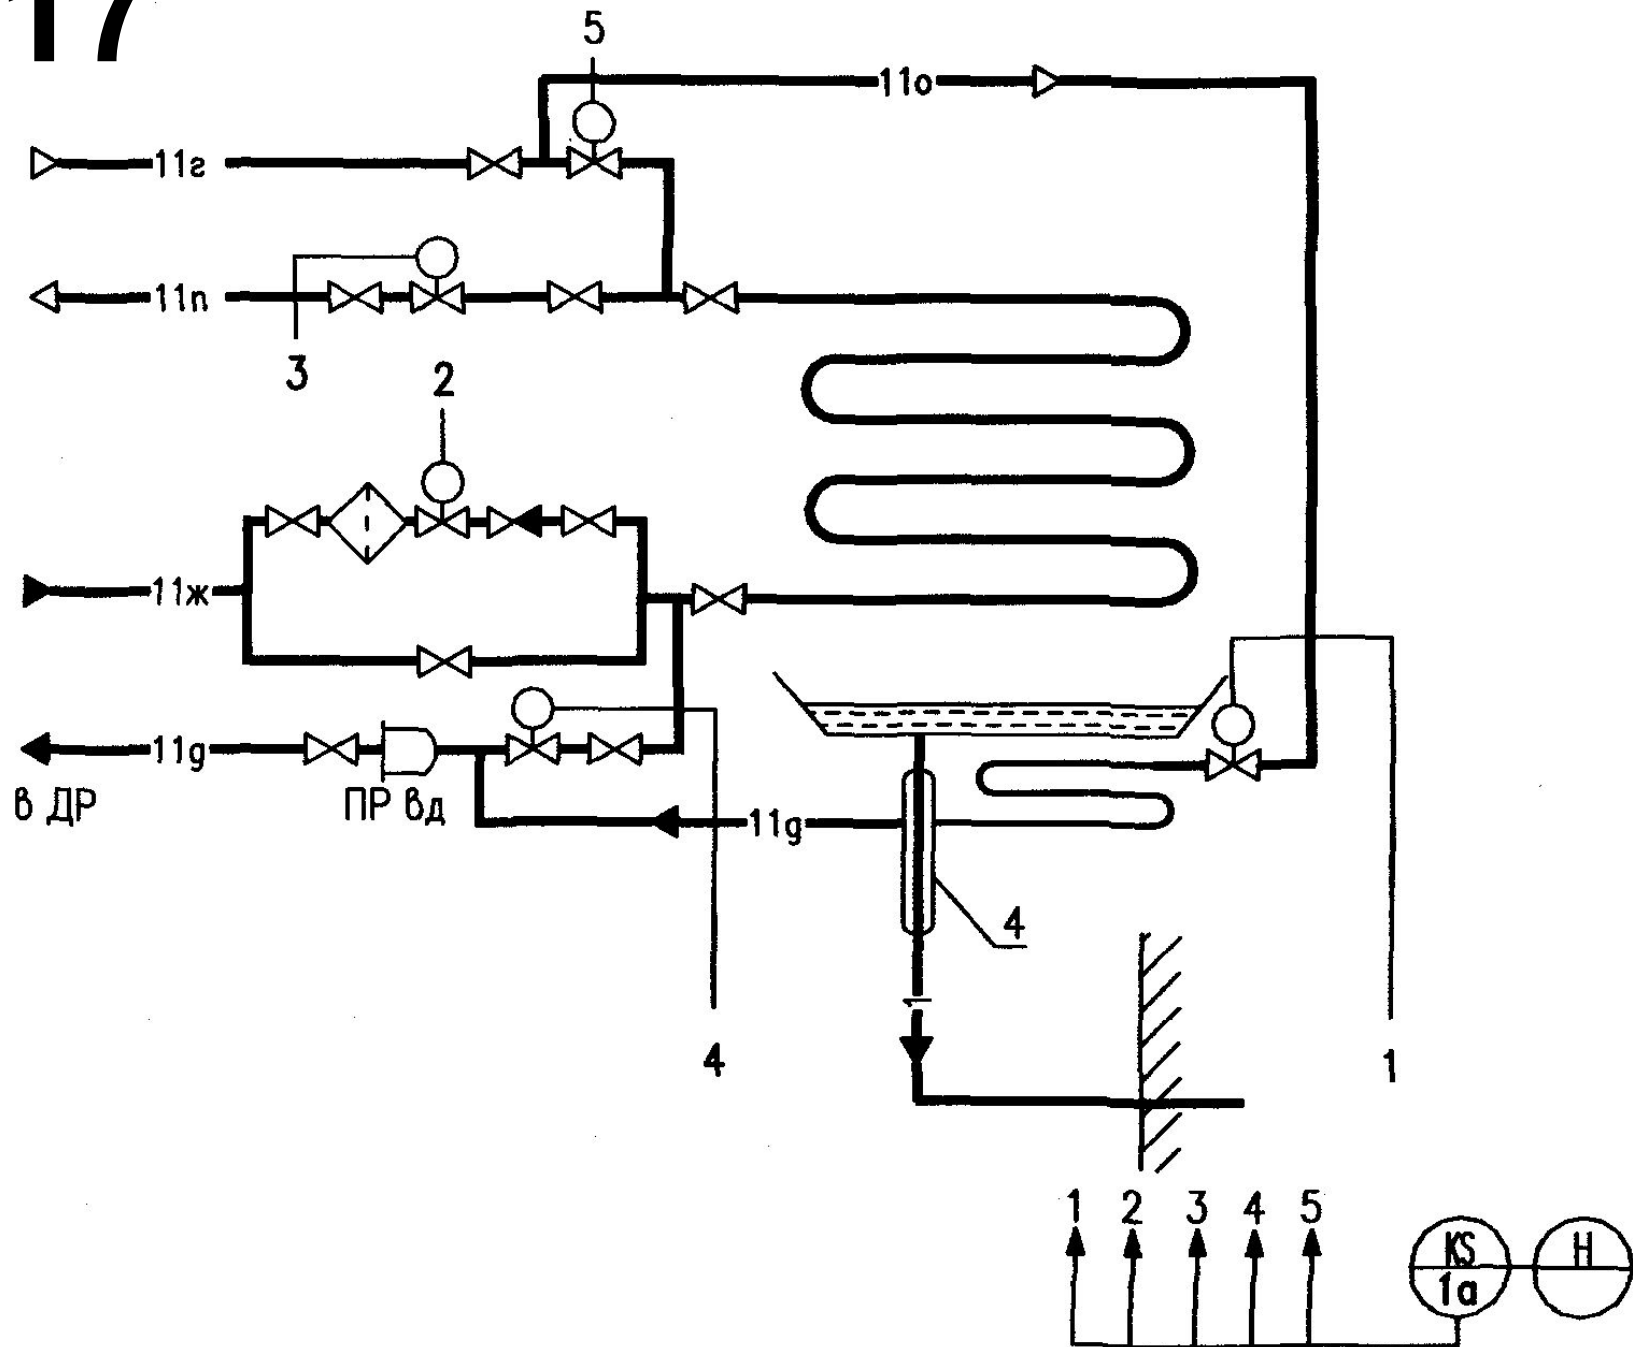


№18

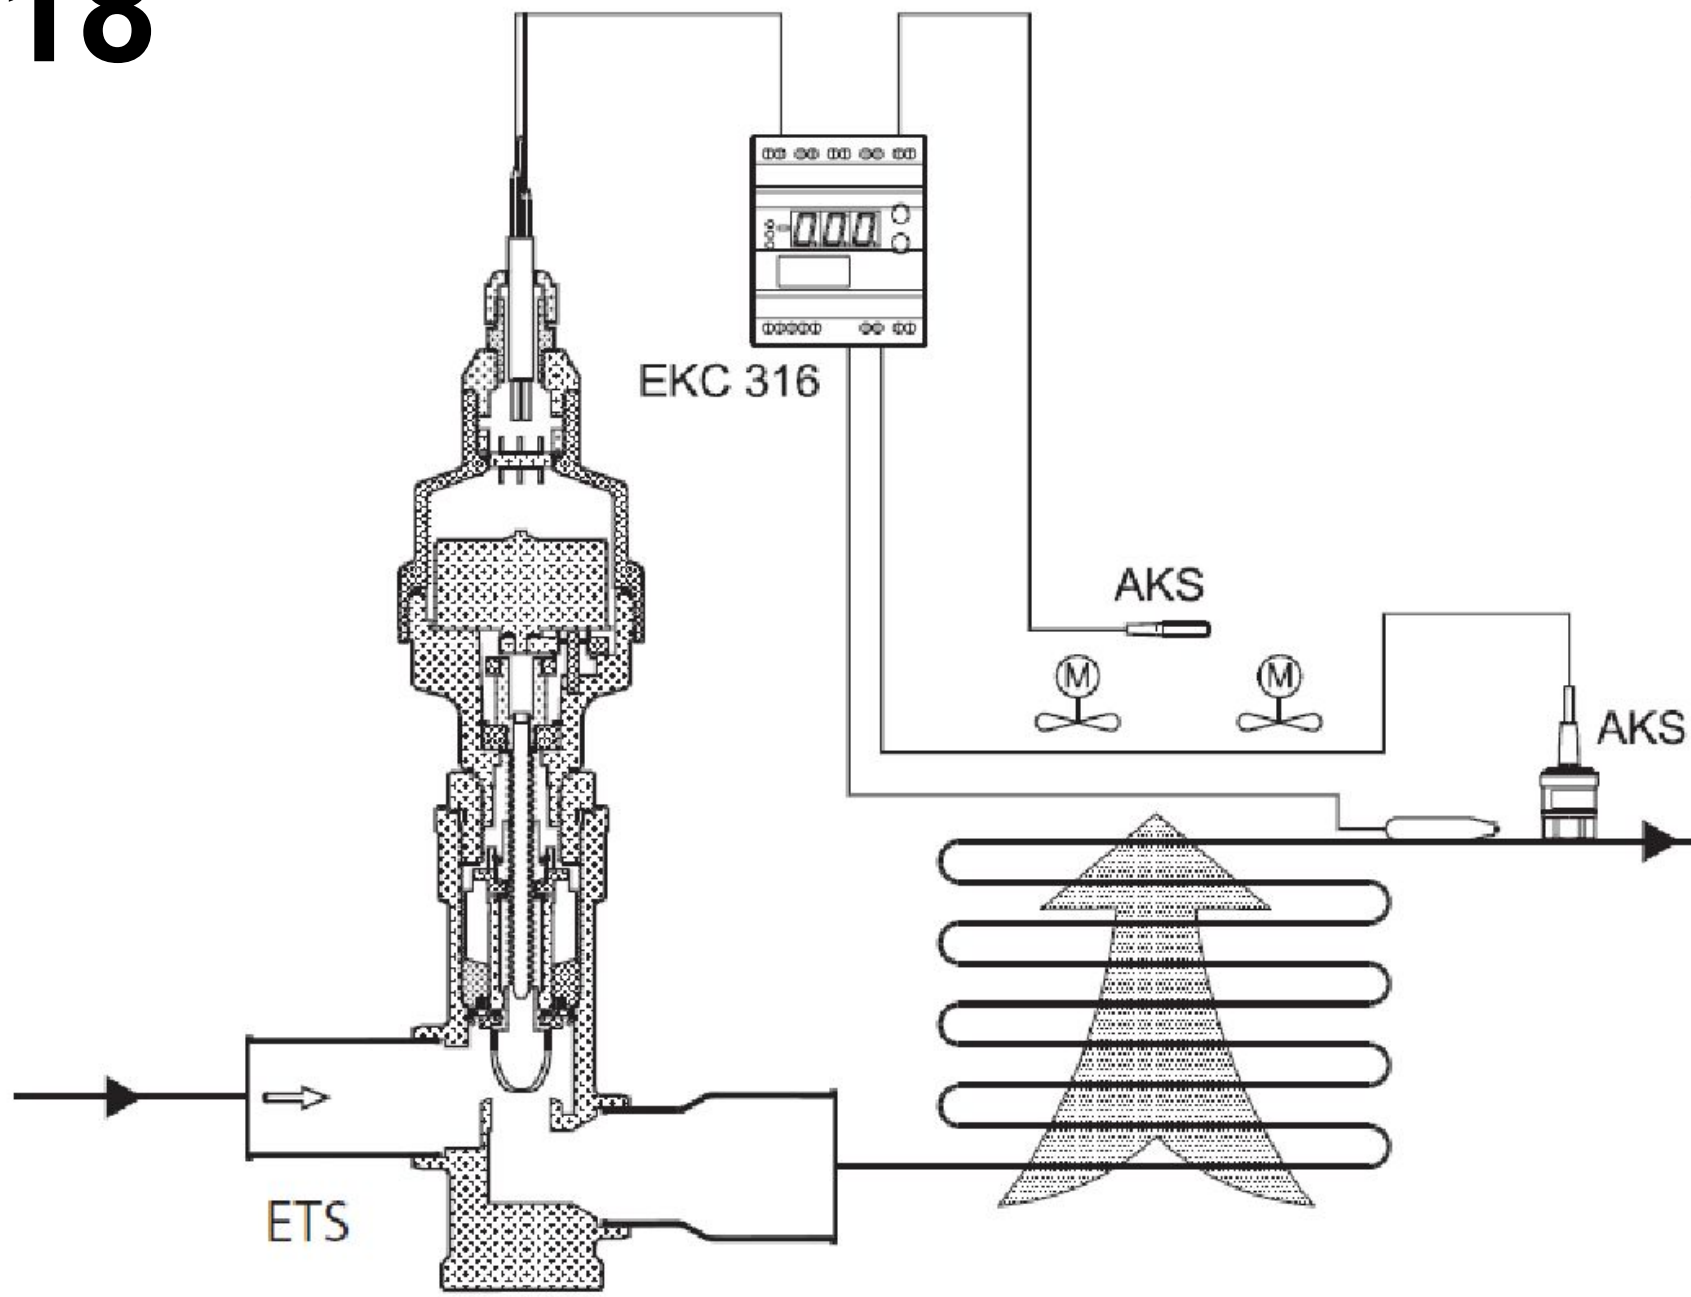

№19

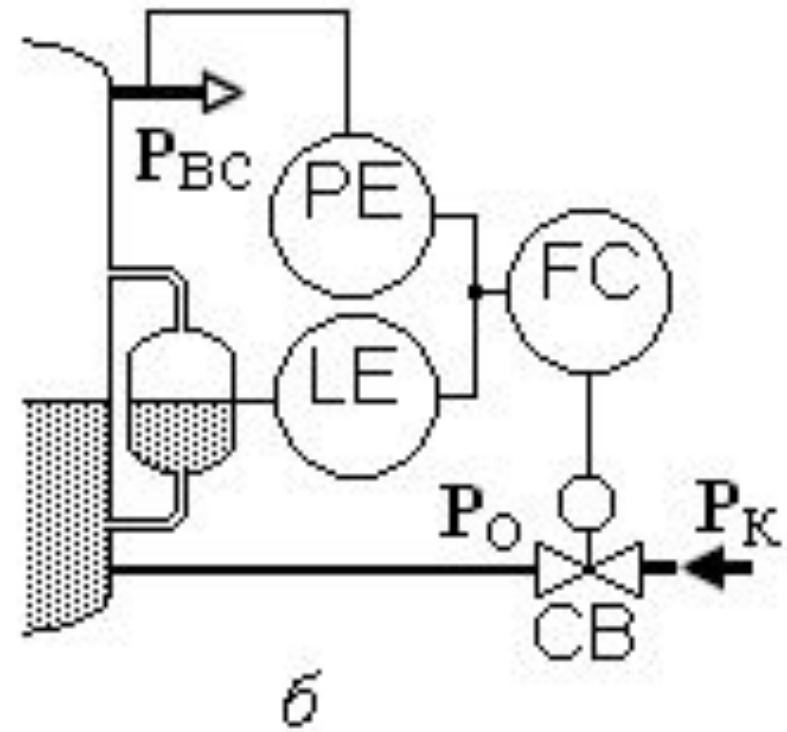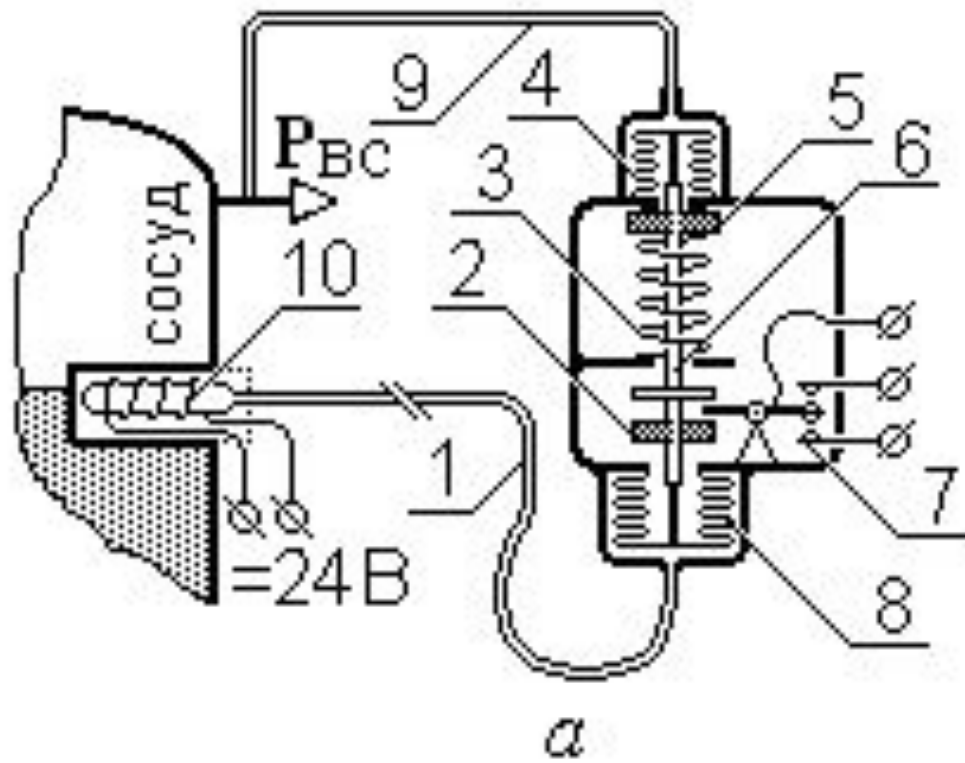


№20


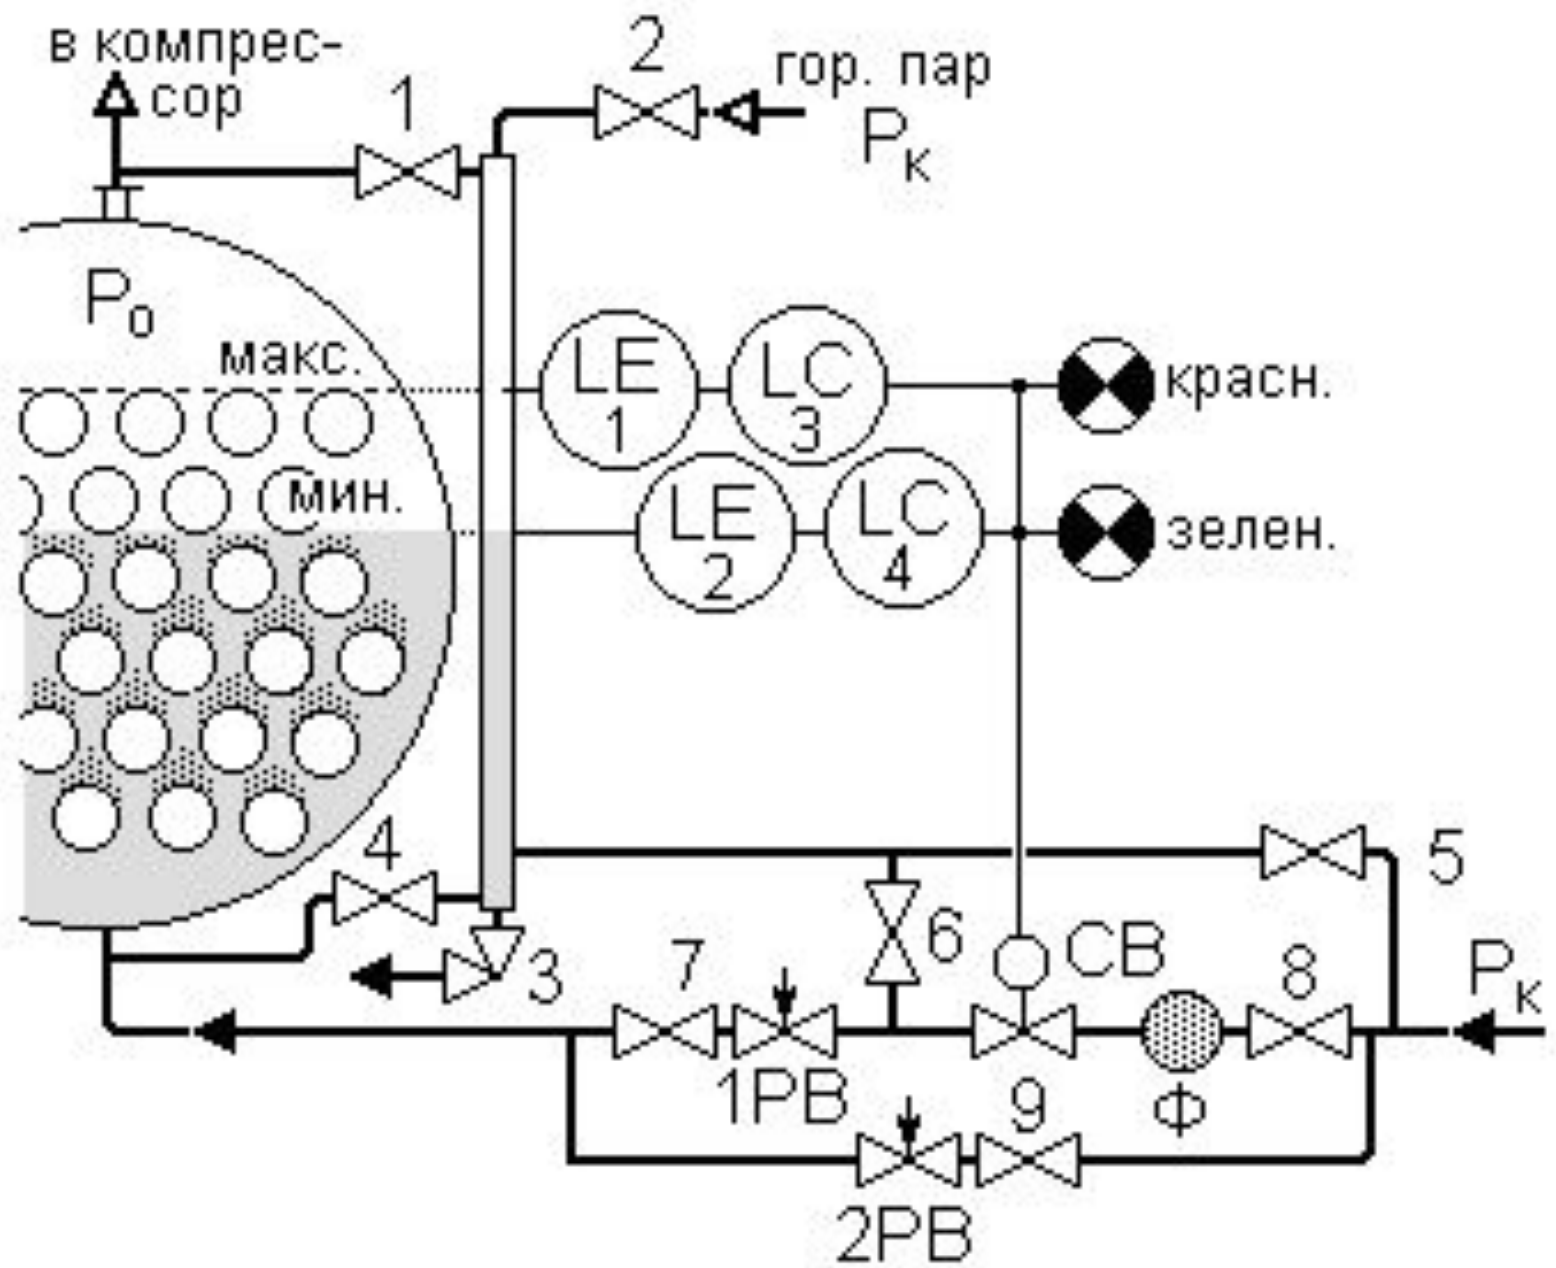


№21


Сеть

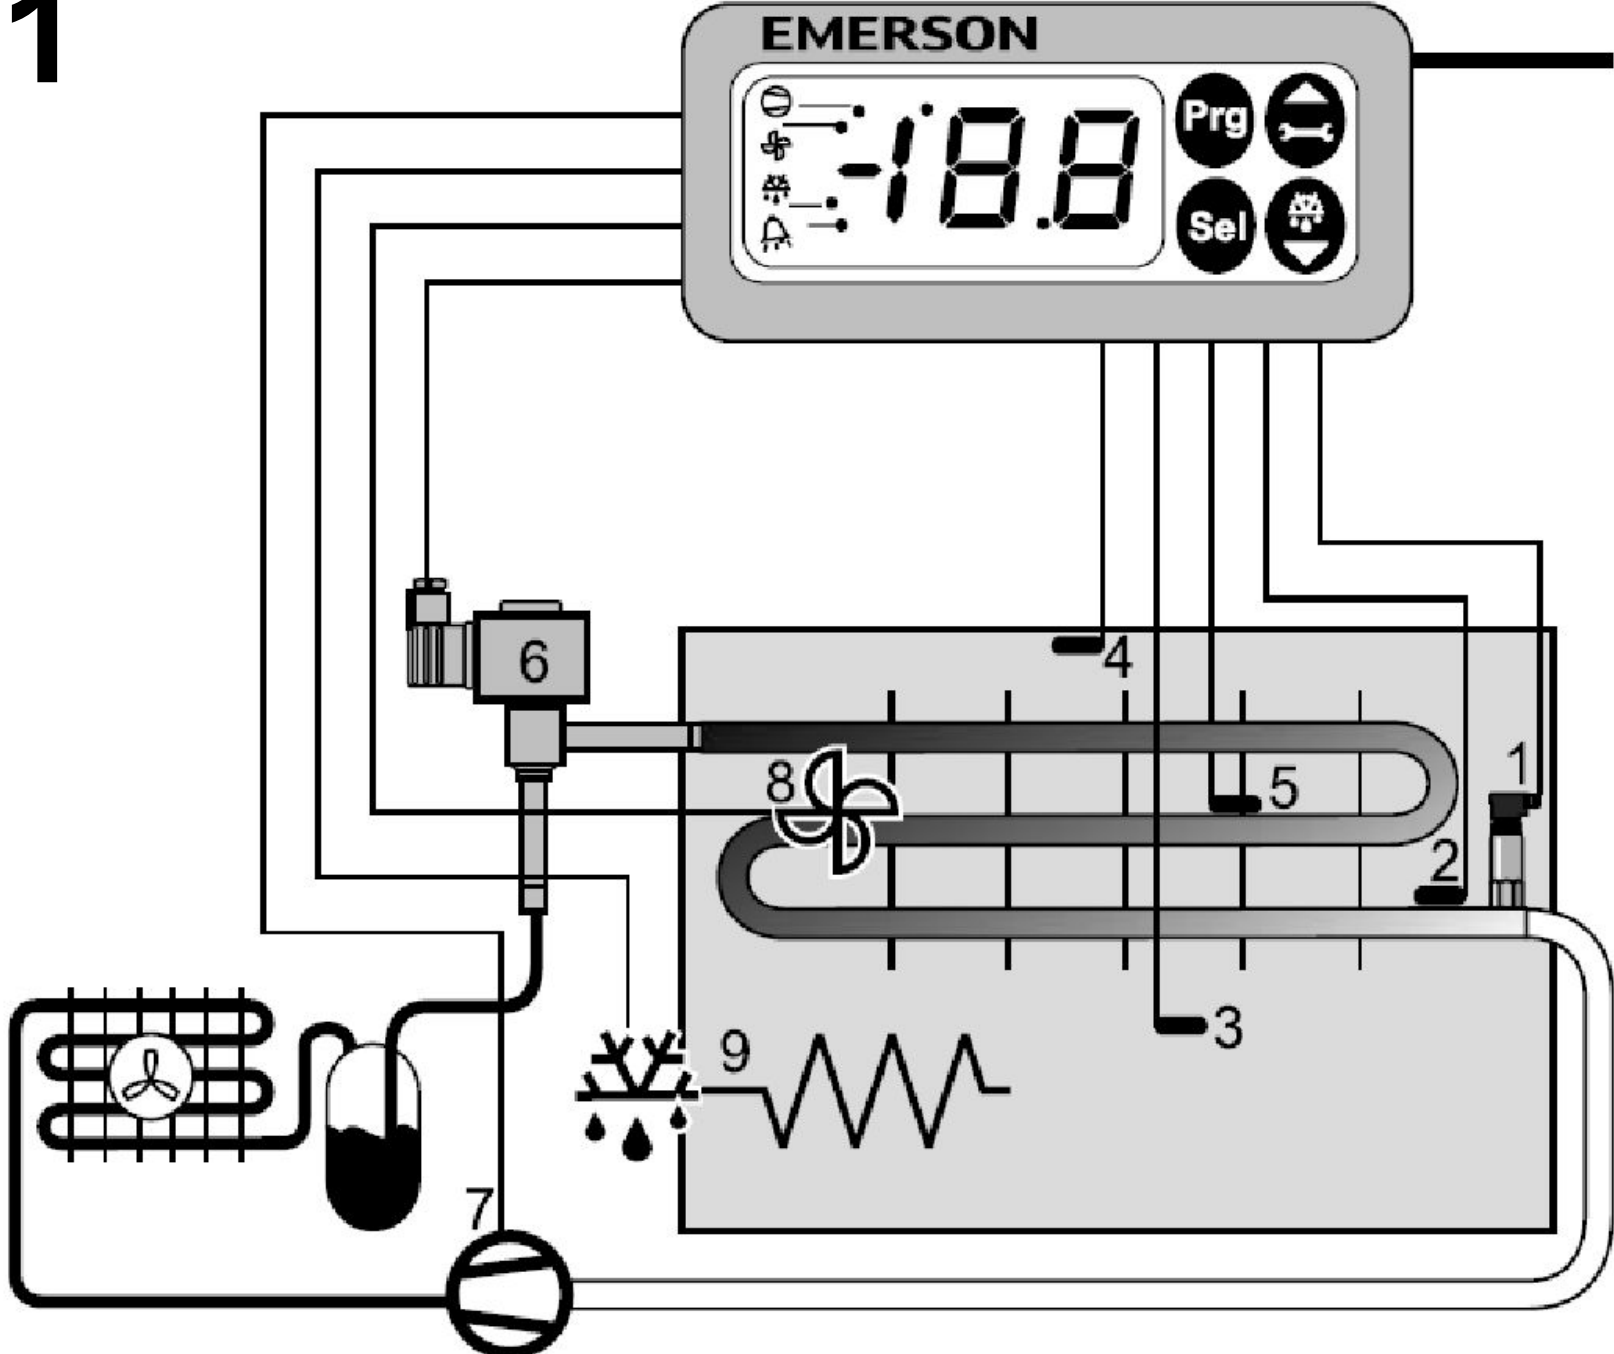


№22

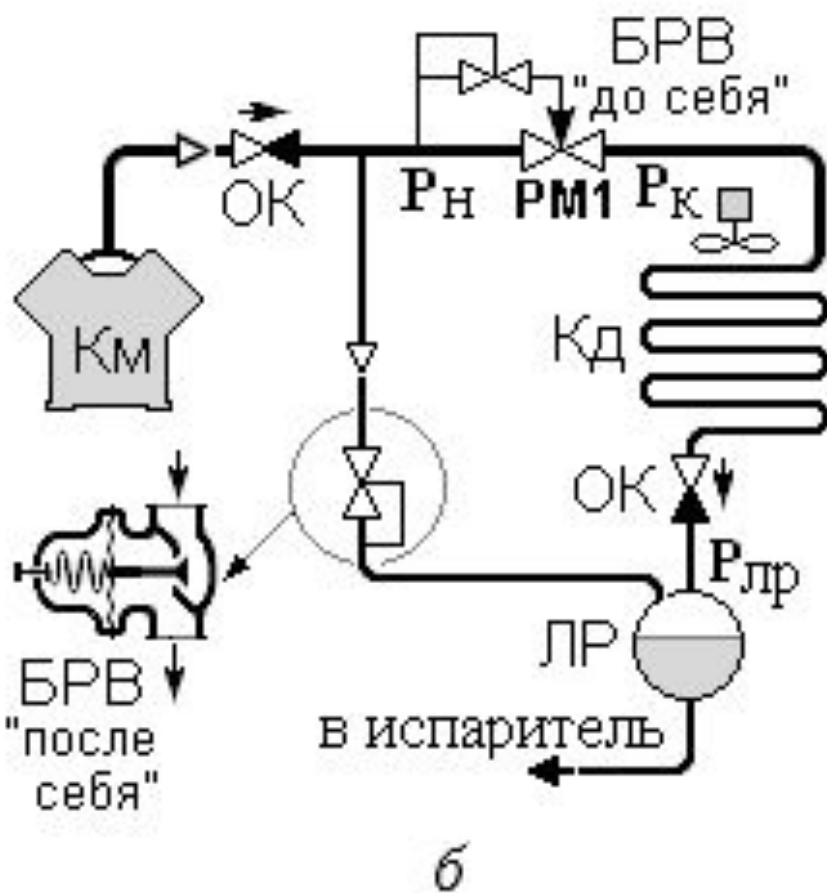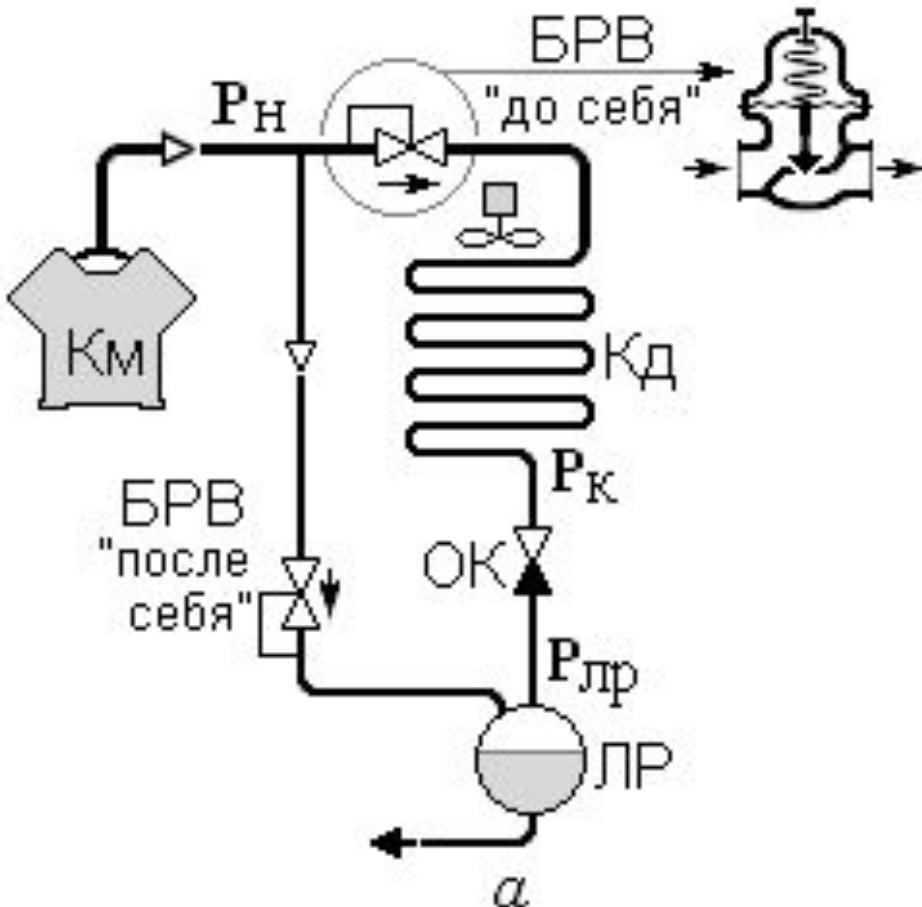


№23

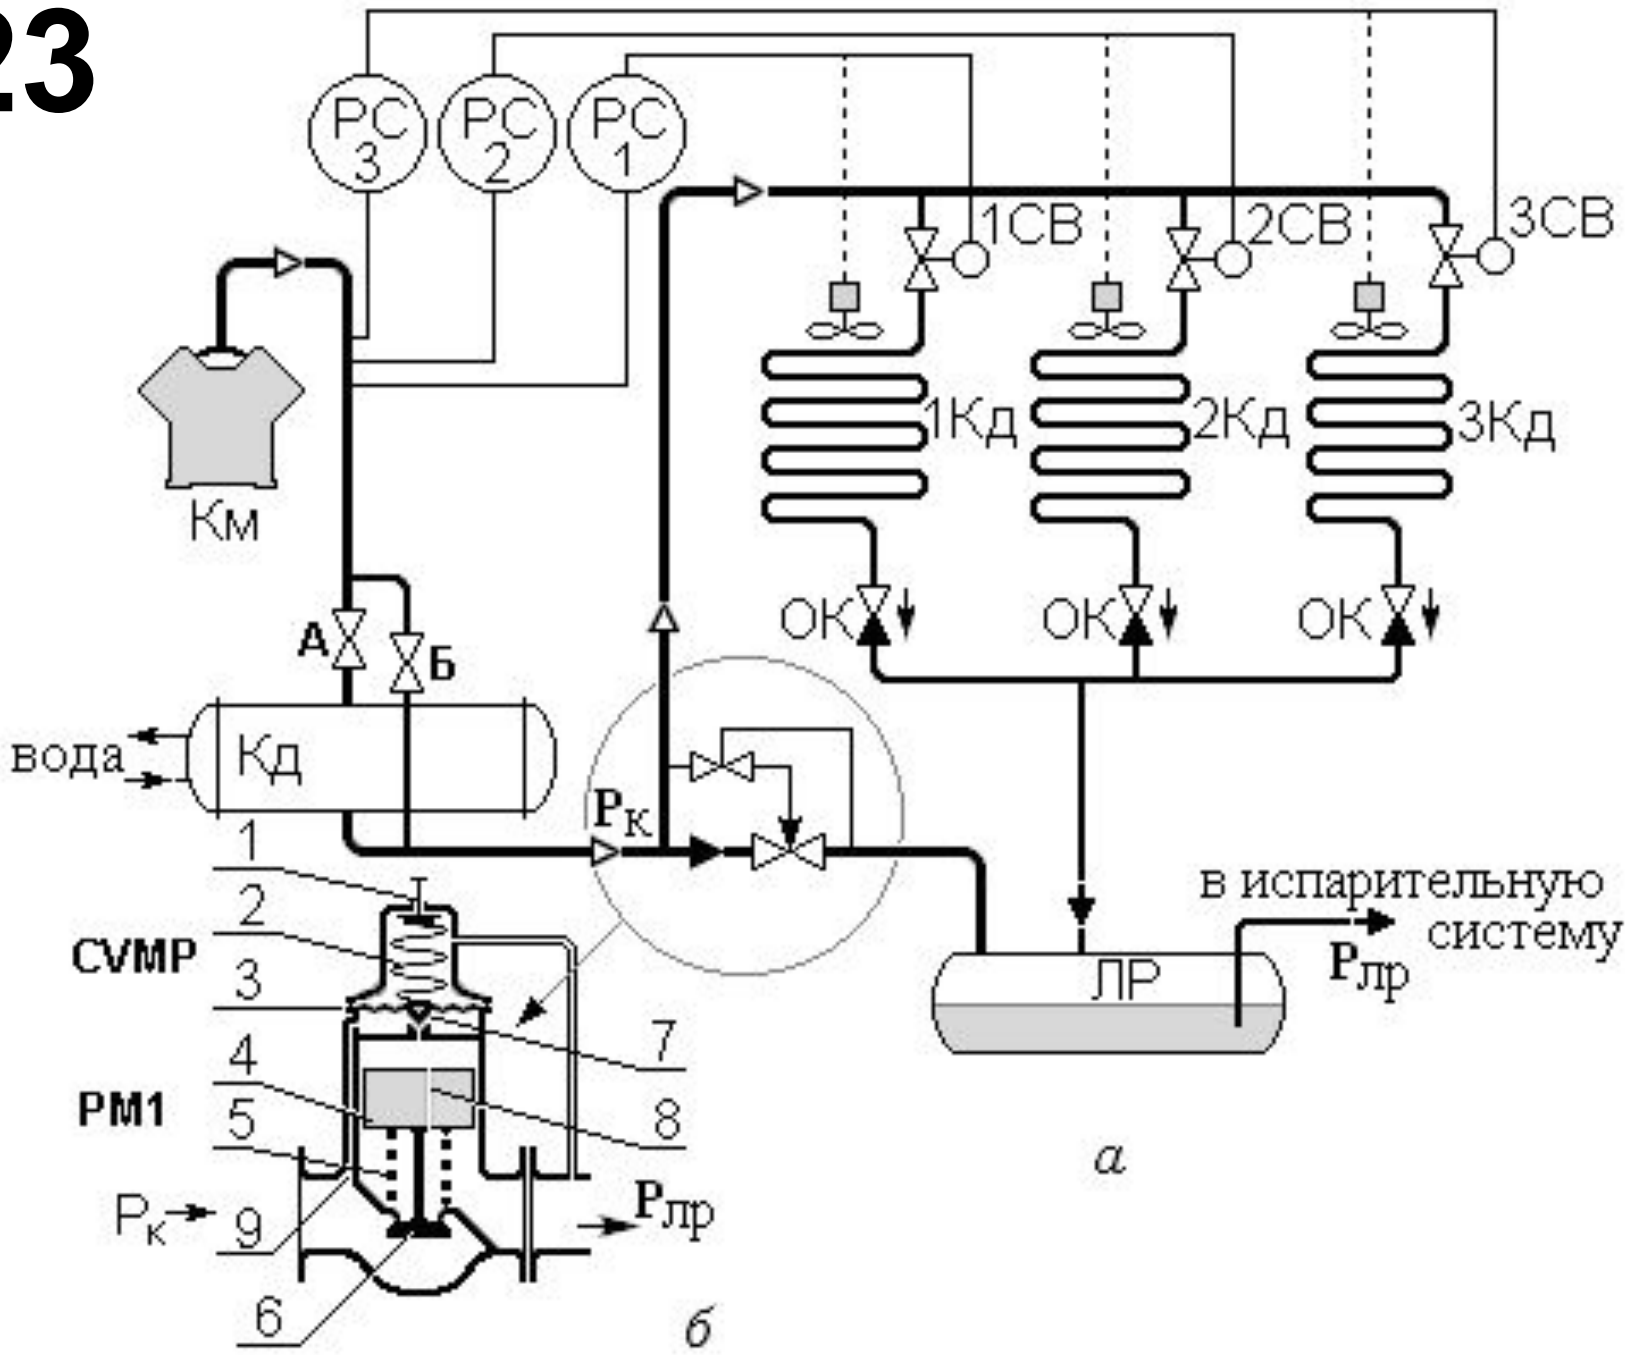

№24

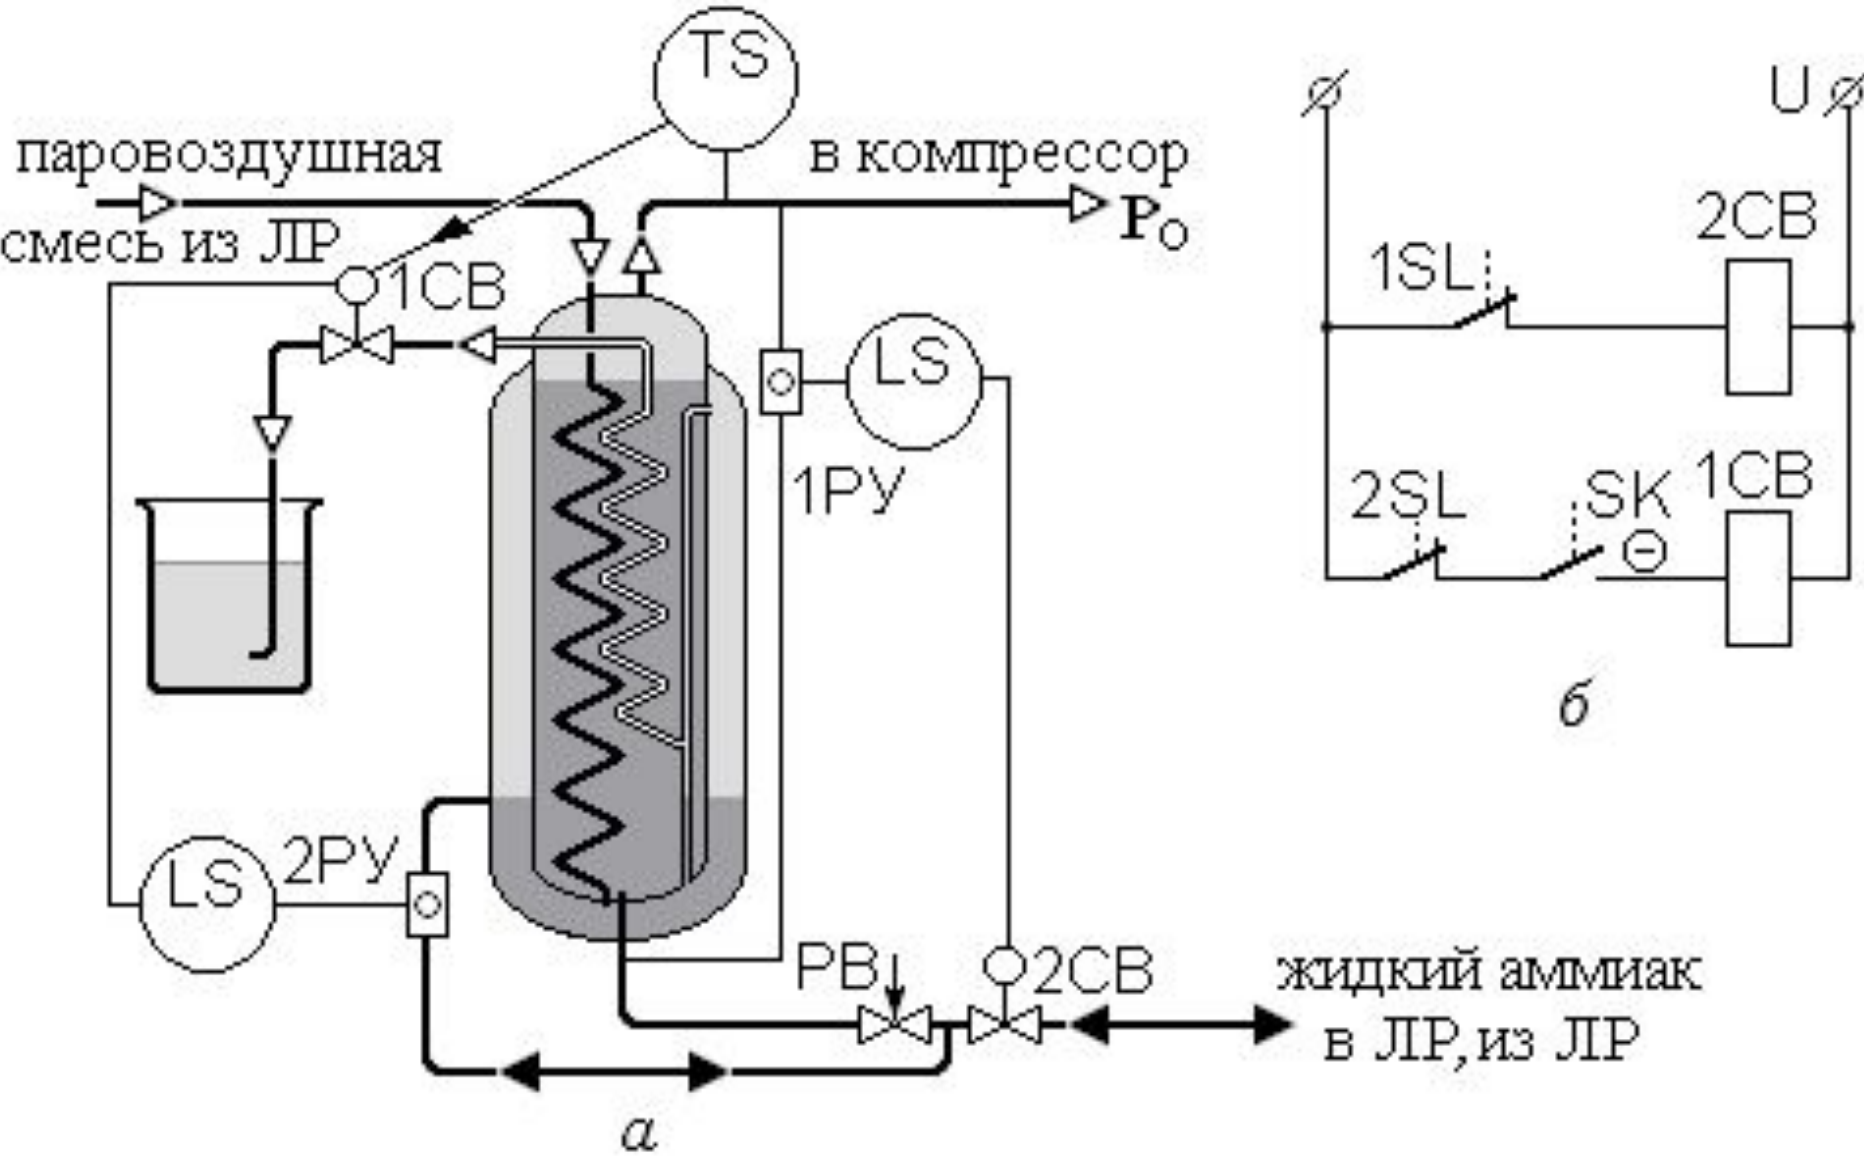

№25

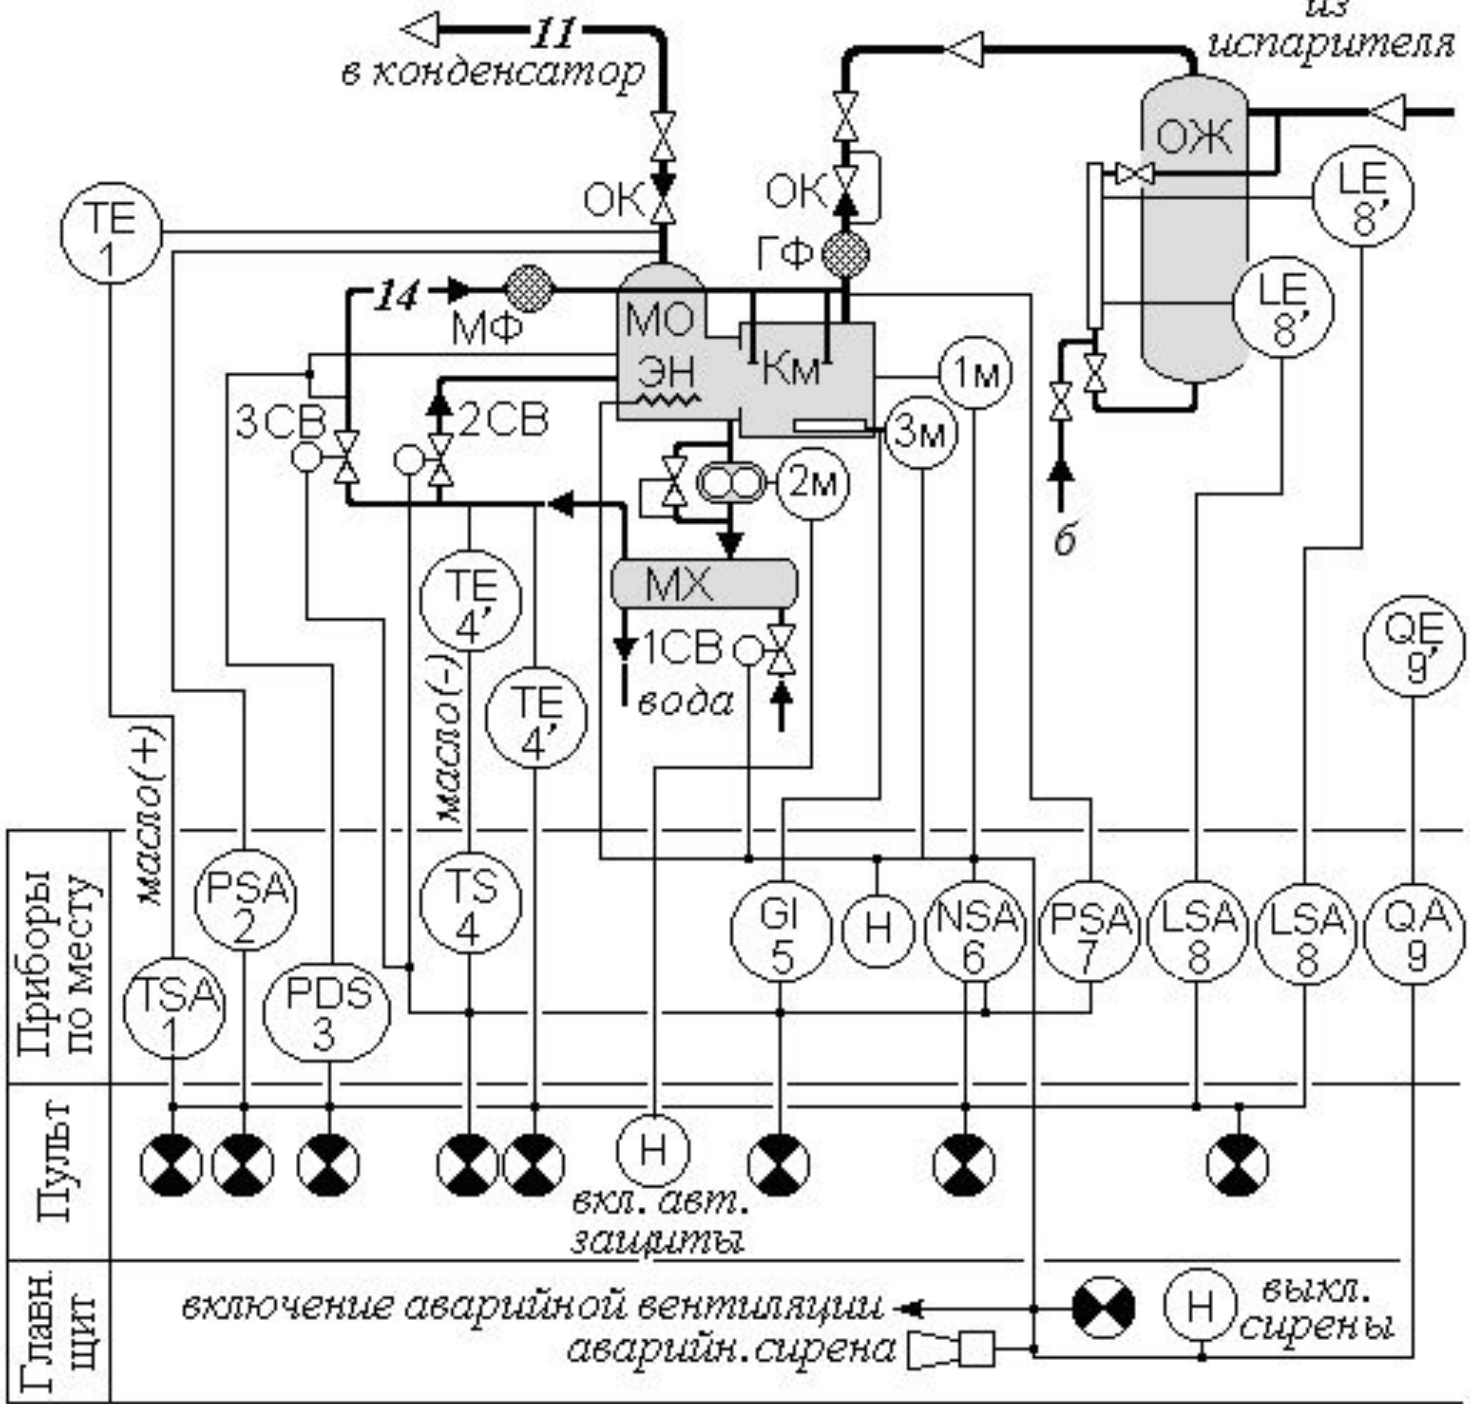

№26

